

WaterNow Volumetric Restriction (VR)

1. 7 Day VR

VR period is 7 days.

Total VR and Peak VR apply to the 7 days.

2. VR is Assigned to Outlets

VR is proportional to block title area. Larger blocks have a higher VR.

3. Peak/Off peak VR

VR has a peak time component from noon to 6pm which applies 7 days a week.

Peak VR is ¼ Total VR (6 of 24hrs).

VR (ML) is displayed in the ordering screen in the format Total/Peak. E.g. 8.1/2.0

Used VR is shown for the two current VR periods.

Used VR changes as orders are placed.

<u>Assessment Detail</u>		(ML)
Water Share		
Domestic & Stock		
Other		
Total Water Share		
Water Available (ABA)		
<u>Water Used To Date</u>		
Water Remaining		
Outlet VR	Used Total / Peak (ML)	End Date
Volume Limit	14.190 / 3.548	.
Period 1	0.000 / 0.000	17/10/2014
Period 2	0.000 / 0.000	24/10/2014
Group VR	Used Total / Peak (ML)	Available (ML)
Volume Limit	22.518 / 5.630	.
Period 1	0.778 / 0.130	21.740 / 5.500
Period 2	0.000 / 0.000	22.518 / 5.630

Up to Total VR may be used to place orders outside of peak time hours.

Orders or parts of orders falling between noon and 6pm may not exceed Peak VR volume.

An order will be rejected if it would cause Total VR or Peak VR to be exceeded.

Start				Finish					
Day	Time	Hours	Amount (l/s)	Day	Time	Volume (ML)	Shift	Receipt No	
26/11/2013	12:00	6	52	26/11/2013	18:00	1.123	1	FAILED second period Peak VR	

4. Grouped VR


Grouped VR is displayed on the web ordering screen (see 3. above).

VR may be shared with upstream outlets on the same Assessment but not usually with downstream outlets.

Submit the "Request Form for Grouping of Outlets" to LMW to assess opportunities for grouping VR.

The form may be downloaded from the LMW Water Ordering web page.

Example:

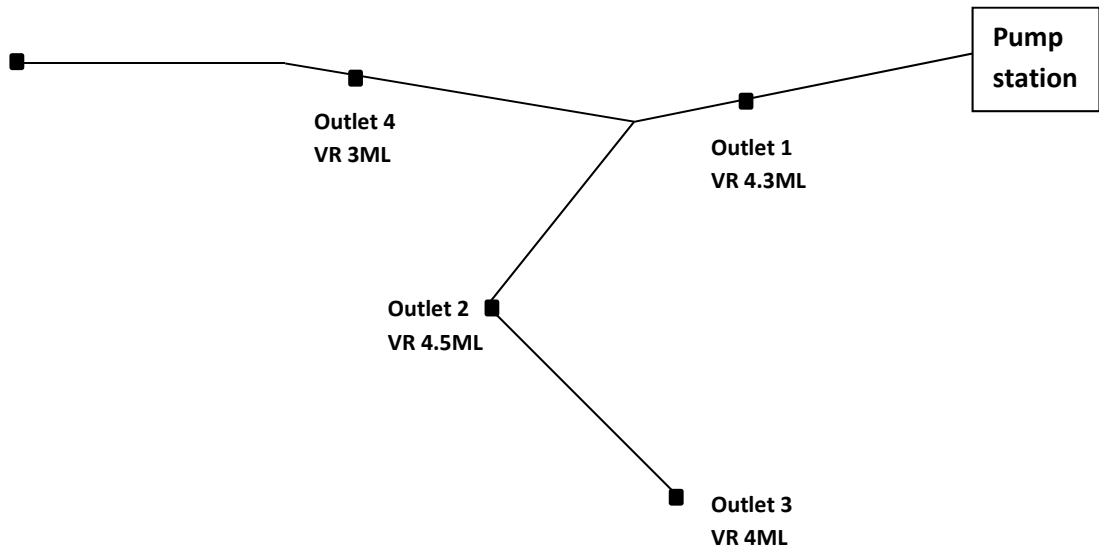

If outlets 1, 2 and 3 have the same Assessment number VR may be grouped as follows:

	Outlet VR (ML)	Grouped VR (ML)
Outlet 1	4.3	12.8
Outlet 2	4.5	8.5
Outlet 3	4	
Outlet 4	3	

If outlets 1, 2, 3 and 4 have the same Assessment number VR may be grouped as follows:

	Outlet VR (ML)	Grouped VR (ML)
Outlet 1	4.3	15.8
Outlet 2	4.5	8.5
Outlet 3	4	
Outlet 4	3	

5. Standby Water

Capacity remaining within 48 hours of delivery time may be ordered regardless of whether the outlet has VR remaining. All of the order must fall within the 48 hours.

Placing a Standby order may push VR Left into the negative. If VR left is negative attempts to edit other orders outside of the Standby period will be rejected, however the other orders may be cancelled outright.