

Annual Drinking Water Quality Report

2024 - 2025



www.lmw.vic.gov.au



Acknowledgement of Country



Kerang Ways by Tobie Cameron

Lower Murray Water acknowledges the Traditional Owners of the land on which we work and reside. We recognise their continuing connection to land, waterways, and community.

We pay our respects to Elders past, present and future. The Traditional Owner groups within Lower Murray Water's service region lie within the traditional lands of First Nations Peoples, from upstream at Koondrook moving downstream along the Murray River (Mil) through to the western edge of our region at the South Australian border.

They are the Barapa Barapa Peoples, Wemba Wemba Peoples, Wadi Wadi Peoples, Tatti Tatti Peoples, Latji Latji Peoples, Nyeri Nyeri Peoples, Ngintait Peoples and the Wergaia Peoples.

The First Nation Peoples' connection to land and water is the living cultural knowledge that is passed down from generation to generation.

The stories that connected the ancestors to their culture still live through the First Nations Peoples of today.

Acknowledgement of Country written by Stephanie Sloane*.

* Stephanie works at LMW as a Diversity and Inclusion Officer. She is a proud Ngiyampa woman and has a strong connection to her culture, history and the land. Stephanie has brought not only her experience and passion for people to this role but also a commitment to inspire and mentor others wishing to pursue a career at LMW.

Table of Contents

Acknowledgement of Country2

Glossary of Terms4

From our Managing Director5

Our Service Region6

Nature and Range of Services Provided7

Water Supply Systems8

Source Water9

Drinking Water Treatment Processes 11

Drinking Water Quality Management 15

Emergency Incident and Event Management 16

Drinking Water Quality Standards.....20

Water Quality Complaints22

Risk Management Plan Audit Results.....24

Regulated Water.....28

Glossary of Terms

ADWG	Australian Drinking Water Guidelines 6, 2011, version 3.9, Updated June 2025.
ADWQR	Annual Drinking Water Quality Report
BGA	Blue Green Algae
CFU/100mL	Colony Forming Units per 100 millilitres
CMA	Catchment Management Authority
DEECA	Department of Energy, Environment and Climate Action
DH	Victorian Department of Health
DWQMP	Drinking Water Quality Management Plan
DWQMT	Drinking Water Quality Management Team
E. coli	Escherichia coli, a bacterial species that are commonly found in human intestines and are used as an indicator of faecal contamination and therefore, is a health risk.
EPA	Environment Protection Authority
ESC	Essential Services Commission
GMW	Goulbourn Murray Water
HACCP	Hazard Analysis and Critical Control Points
THMs	Trihalomethanes
NTU	Nephelometric turbidity units
mg/L	Milligrams per litre
NATA	National Association of Testing Authorities
NTU	Nephelometric turbidity units
OFI	Opportunity for Improvement
RPZ	Reduced Pressure Zone
SDWR	Victorian Safe Drinking Water Regulations 2015
The Act	Safe Drinking Water Act 2003 (Vic)
THMs	Trihalomethanes
Water Sampling Locality	An area that has common water quality characteristics because the supply is provided through specific pipes, tanks or pumps. It is more likely to follow geographic features than suburb boundaries.
WTP	Water Treatment Plant
WIOA	Water Industry Operators Association

From our Managing Director

I am pleased to present Lower Murray Urban and Rural Water Authority's (LMW) 2024/25 Annual Drinking Water Quality Report (ADWQR). It provides comprehensive information on the quality of drinking water we have provided to our customers and community throughout LMW's service area, which extends from Kerang to the South Australian border, in the municipalities of Gannawarra, Swan Hill and Mildura. The report highlights all the test results from our water quality monitoring program and outlines the processes we have in place to continue delivering safe, clean drinking water to all.

This report is provided to the Secretary to the Department of Health (DH) in accordance with section 26 of the *Safe Drinking Water Act 2003* (the Act), and Regulations 16 and 17 of the *Safe Drinking Water Regulations 2015* (the Regulations). This report includes a summary of the chemical, physical and bacteriological test results of drinking water supplied to our customers, as part of our water quality monitoring program for each water sampling locality.

The information presented in this report explains the sources of our drinking water and how it is treated to ensure it consistently meets regulatory requirement. It further demonstrates our commitment to delivering water of high-quality standards, and highlights water quality challenges experienced as well as our improvements in 2024/25.

In addition to the above, the report includes the following information:

- an overview of our water supply systems and sources of our water supply.
- a summary of water treatment and disinfection processes.
- an outline of how we arrange collection and testing of water samples.
- details of customer feedback regarding water quality and safety.

LMW is a statutory water authority created under the *Water Act 1989* and governed by a board of non-executive directors appointed by the Minister for Water. We work closely with the Environment Protection Authority (EPA), the DH and the Essential Services Commission (ESC), as they regulate and monitor the service performance of our environmental, public health, and water pricing obligations.

In accordance with the Act, we have adopted a multiple-barrier, catchment-to-tap approach to ensure safe, high-quality drinking water is supplied to our customers. We are also required to prepare and implement a Drinking Water Quality Management Plan (DWQMP) to ensure the safety of our drinking water supply systems. Our DWQMP is based on Hazard Analysis and Critical Control Point (HACCP) principles and the Australian Drinking Water Guidelines 2011 (ADWG). The DWQMP was audited in March 2023 and LMW was compliant with 18 Opportunity for Improvement (OFI) noted.

We verify the quality of the drinking water through a comprehensive monitoring program that also allows us to identify potential improvements to benefit our customers and the community. We also rely upon feedback from customers to advise of local issues that may arise, which are treated as water quality complaints.

LMW is committed to continuing its record of reliably providing high quality, safe drinking water to our customers. I'm pleased to advise that we achieved full compliance with the water quality standards and requirements of the Act and Regulations.



Paul Northey
Managing Director

Our Service Region



Our area of operation extends from Kerang to the South Australian border taking in the municipalities of Mildura, Swan Hill and Gannawarra. We recognise that the overall wellbeing and livelihood of our communities' is directly linked to the agricultural, tourism and support industries which form our economic backbone. How we manage our water resources recognises the intrinsic interrelationship between this resource and the social, environmental and economic fabric of our region.

Nature and Range of Services Provided

LMW provides services to rural and urban customers including:

- Urban water services to 14 townships via nine treatment plants to 34,784 households and businesses and approximately 77,137 customers along the Murray River from Koondrook to Merbein.
- Wastewater collection, treatment and effluent re-use and disposal services to 11 towns via nine treatment plants.
- Raw (river quality) water services to 2,666 irrigation and 2,240 stock and domestic customers in the four pumped irrigation districts of Mildura, Merbein, Red Cliffs and Robinvale, and to 297 Millewa waterworks district customers and 12 Yelta waterworks district customers.
- Management of the region's urban and rural bulk water entitlements.
- The collection and disposal of subsurface drainage water from the four pumped irrigation districts, as well as from private diverters in Nangiloc, Robinvale and Boundary Bend.
- Oversight of irrigation and drainage design in new agricultural developments ensuring conformity with salinity management plan development guidelines.
- Management of the private diversion licences of 1,313 water users along the Murray River in Victoria between Nyah and the South Australian border.
- The assessment and approval of licensing, water share and allocation trade applications.
- Reclaimed water for third party use.
- Water supply delivery to important environmental and recreational sites.
- Lead agency in a partnership model for the Victorian Murray Floodplain Restoration Project (VMFRP).

In addition to security of supply, public health, water quality and environmental responsibilities, LMW recognises the crucial economic role of water from a regional and state context.

Water Supply Systems

LMW manages eight drinking water supply systems, which provide drinking water to a population of approximately 77,137 customers along the Murray River in Victoria from Kerang to Merbein. LMW also has two regulated water supplies, including Millewa and Mystic Park. A water quality improvement plant operates at Millewa to improve water quality for domestic and stock uses, but not for drinking. Regulated water is not drinking water but could be mistaken for drinking water and is discussed in more detail in the Regulated Water section of this report.

Details of our drinking water and regulated water supply systems, including water sampling localities, population supplied, source water and Water Treatment Plants (WTPs) are provided in Table 1. We do not manage raw water storages for drinking water supplies as we draw directly from the Murray River or other smaller waterbodies.

The population figures have been calculated based on the number of water connections as of 30 June 2025 (31,642) multiplied by the 2021 Census average household population for each region. Non-residential connections are not included. Locations of drinking water supply systems are shown on the map of our service region. This report, in accordance with the Act, provides an overview of our drinking water supply systems, the quality systems in place for provision of safe drinking water and the drinking water test results for 2024/25.

Table 1 - LMW Water Supply Systems

Water Sampling Locality	Population	Source Water	Treatment Plant
Irymple	8,546	Murray River	Mildura 7th Street Mildura West
Kerang	4,105	Murray River 14/2 Irrigation Channel	Kerang
Koondrook	1,080	Murray River	Koondrook
Lake Boga	1,153	Murray River	Swan Hill
Merbein	3,660	Murray River	Mildura 7th Street Mildura West
Mildura	37,551	Murray River	Mildura 7th Street Mildura West
Murrabit	104	Murray River GMW Channel	Murrabit
Nyah	647	Murray River	Swan Hill
Nyah West	307	Murray River	Swan Hill
Piangil	265	Murray River	Piangil
Red Cliffs	4,160	Murray River	Red Cliffs
Robinvale	2,436	Murray River	Robinvale
Swan Hill	12,271	Murray River	Swan Hill
Woorinen South	427	Murray River	Swan Hill
Millewa*	297	Lake Cullulleraine	Millewa Water Quality Improvement Plant
Mystic Park*	28	Kangaroo Lake	N/A
Total	77,137		

* Regulated Supplies

Source Water

The source of water for most of the drinking water supplies in our service region is the Murray River. Two exceptions to this are the Kerang and Murrabit drinking water supplies. The Kerang supply system sources its water from Goulburn Murray Water's 14/2 Irrigation Channel in addition to the Murray River. The Murrabit drinking water supply source its water either from the Murray River or from a storage dam at the plant, which is supplied from the Goulburn Murray Water channel, during times of Blue Green Algae (BGA) blooms along the Murray River.

LMW's regulated water supplies source water from Kangaroo Lake and Lake Cullulleraine (supplied from the Murray River) for Mystic Park and Millewa areas respectively.

The Murray River catchment (part of the Murray-Darling Basin) covers a large area that spans Victoria, New South Wales and Queensland. Water from Queensland catchments enters the Murray River downstream of Mildura, so does not impact on our WTPs' raw water offtakes. Several other water agencies located upstream of our offtakes also utilise the Murray River to provide drinking water to major towns along the Murray River including Albury, Wodonga, Cobram, Echuca and other smaller localities.

In 2015, we carried out a sanitary survey to identify the intensity and sources of contamination of water sources within the catchment area of our service region. The results indicated that the Murray River catchment is subject to various activities, which impact on water quality. Murray River lies within an open and unprotected catchment, where various activities such as stock grazing, human habitation, agriculture and industry take place. Dominant agricultural activities include extensive horticultural areas, the production of almond, olive, dairy, wool, wheat, beef, lamb and forestry. An abundance of recreational activities is undertaken along the Murray River and its tributaries including camping, swimming, fishing, water skiing, canoeing, sightseeing and picnicking.

As a result, Murray River water is subject to a high microbial and chemical risk from humans, stock and industry. To assess that LMW's water treatment processes can manage these risks, we have a source water quality monitoring program, which involves collecting and testing of source water samples for a range of parameters such as turbidity, colour, UV absorbance, pesticides, radioactivity, etc. to help assess risks from the catchment. In addition, the raw water turbidity is monitored online at all WTPs, which provides an early warning to treatment plant operators of potential changes to the raw water quality. This enables operators to undertake control measures to ensure adequate treatment is applied to the raw water and potential for process deviation is reduced.

To quantify the microbial risks in the catchment and realising the similarities in each catchment and the microbial hazards, we conducted a detailed microbial hazard quantification assessment on our drinking water supply systems in 2024. The assessment used the methodology outlined in ADWG and the Water Services Association Australia (WSAA) Manual for the Application of Health Based Targets for Drinking Water (2015).

LMW has been monitoring *Cryptosporidium* and *Giardia* in the source water since January 1998. The monitoring frequency has changed to fortnightly and includes *E. coli*, to enable ongoing quantification and assessment of the source water risks.

LMW conducts seasonal monitoring of BGA to detect their presence. When any blooms are detected, appropriate and robust control measures are employed to the treatment process to ensure that water is safe for drinking and compliant with ADWG. Frequency of BGA monitoring is weekly which can be increased conditional to the levels of BGA identified in source water.

Catchment Management

LMW always endeavours to reduce potential risks to water quality in the Murray River being the main source of water supply for our water supply systems.

LMW is an active partner in the state-wide program that collects water and groundwater data, called the Regional Water Monitoring Partnership managed by Department of Energy, Environment and Climate Action (DEECA).

LMW work closely with Mallee Catchment Management Authority (CMA) to assess the risks of chemical contaminants in irrigation drainage water. We are a participating member of the Mallee CMA's Mallee floodplain management strategy implementation committee. This committee seeks to understand flooding risks for our region and coordinate a response to these risks with multiple agencies via development and implementation of mitigating actions. Actions to date include mapping floodplains to help understand future flood risks and the building of strategically placed levees.

LMW is a member of the Mallee CMA's Regional Catchment Steering committee which is in the process of renewing the Regional Catchment Strategy, a document which underpins the sustainable management of land and water resources and contributes to biodiversity management.

LMW regularly partners with Mallee CMA to flush Psyche Bend Lagoon on a high river, to reduce the salt load in the lagoon using LMW infrastructure. While this sounds counterproductive to water quality, this activity prevents highly saline waters to enter the river when a rain event occurs during a low river, which can trigger an electroconductivity exceedance in Morgan SA, and compromises water quality for LMW offtakes downstream. By doing this on a high river, the salinity is effectively diluted and poses no problems for water quality downstream of the lagoon.

Drinking Water Treatment Processes

During 2024/25, LMW treated around 20,000 megalitres of drinking water across nine WTPs. All these WTPs use conventional water treatment systems, with one WTP utilising dissolved air flotation as part of its treatment system. The water treatment systems involve the following process steps:


- coagulation
- flocculation
- clarification/sedimentation/dissolved air flotation
- filtration
- chlorine disinfection
- fluoridation
- pH correction
- UV disinfection

Our drinking water is disinfected using chlorine, the most widely used disinfectant in the water industry. Chlorine dose rates are adjusted to provide adequate free chlorine residual throughout the distribution system. This helps provide some protection against potential contamination within the reticulation system and can limit biological regrowth. LMW has recently completed the UV project to retrofit all nine drinking WTPs with UV disinfection systems, which provides the additional barrier for Protozoa in line with the ADWG recommendations and industry best practice.

Water treatment processes may slightly differ from one WTP to another due to plant capacity, technology type or raw water quality characteristics of source water. Steps in the drinking water treatment process are outlined in Figure 1.

Table 2 shows water sampling localities, WTPs that supply water to those localities, treatment processes used to treat the water per locality, and chemicals used for water treatment.

Figure 1. Drinking Water Treatment Processes

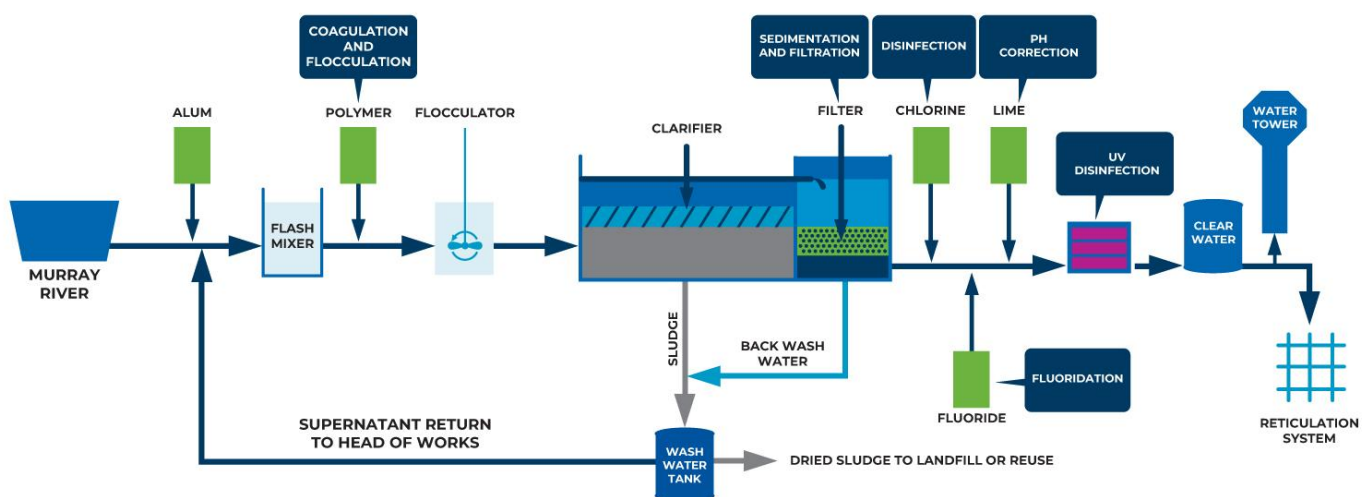

Coagulation and Flocculation

The first step of the conventional treatment process involves dosing a chemical coagulant to help gather suspended solids and organic material in the raw water. We use aluminium sulphate or aluminium chlorohydrate to bring about the coagulation process, which helps form larger particles called 'flocs' that can be more readily removed by subsequent treatment steps. During flocculation, the floc particles develop and agglomerate into larger particles. The larger size and weight of the agglomerated particles assists in the sedimentation or clarification process. Flocculant aids including polyelectrolytes are also commonly used to enhance the flocculation phase, which further assists in the sedimentation and clarification processes.

Sedimentation

Sedimentation is a step in the treatment process intended to enhance the filtration process, where suspended particles are removed from the water by means of gravity or separation. In the sedimentation process, the water passes through a relatively quiet and still basin. In these conditions, the floc particles settle to the bottom of the basin while 'clear' water passes out of the basin over an effluent baffle or weir. The solids collected on the bottom of the basin are removed through sludge bleeding pipework at the smaller "package" WTPs, or by a mechanical 'sludge collection' device at the larger plants, which scrapes the solids (sludge) to a collection point within the basin from which it is pumped to a storage for further treatment and disposal.

Solid Contact Clarification

The purpose of the solid contact clarification is the same as the sedimentation process, i.e., to enhance the filtration process by removing particles. It involves mixing the influent flow with previously settled solids within a cylinder located in the centre of the clarifier. Gentle mixing within the reaction well promotes agglomeration of floc particles and/or chemical precipitates. The aggregated solids settle out more rapidly in the clarification area. Even better clarity is achieved when particles become enmeshed in a sludge blanket layer. Rotating sludge scrapers transport settled solids to the centre of the basin for removal. Clarified overflow is removed through a circular launder system that draws water from the entire surface area to prevent solids carryover caused by uneven velocity currents.

Dissolved Air Flotation (DAF)

The process of flotation consists of three steps:

- bubble formation
- attachment of bubbles to the solids
- solids separation from the fluid

In DAF systems, air is pressurised under several atmospheres and then introduced into water, where it is mixed with pre-coagulated water just before it enters the flotation tank.

Upon attachment of air bubbles to the solid particles, the density of the solid becomes less than that of the surrounding fluid. In the process, the buoyant force lifts the solids to the surface to form a scum blanket, which is continuously swept to the periphery, automatically discharged into a scum trough by the skimming device.

Filtration

Filtration occurs as the water passes through filters that help remove particles that have not settled in the sedimentation process. Filters are commonly used in the water treatment process and may contain layers of gravels, sands and filter coal. The filtration process removes fine suspended solid matter as well as some other particles including larger micro-organisms, resulting in clear water passing through.

Disinfection with Chlorine Gas

Water is disinfected to kill any pathogens (disease-causing organisms) that remain in the treated water after filtration and provide protection within the distribution system. Without disinfection, the risk from waterborne disease is greatly increased. Disinfection is carried out by chlorination at all our WTPs in the form of chlorine gas.

Ultraviolet (UV) Disinfection

UV disinfection is widely used in water treatment due to its ability to permanently deactivate bacteria, spores, moulds and viruses. It provides an additional barrier to the conventional water treatment process, where filtration is the only barrier against protozoan pathogens, such as *Cryptosporidium* and *Giardia*. UV disinfection is highly effective against the *Cryptosporidium* oocysts and *Giardia* cysts that are resistant to the routinely applied doses of chlorine.

pH Correction

Due to the addition of coagulants and chlorine, the pH of the water being treated is lowered, becoming more acidic. To inhibit corrosion and make the water safe to use, the pH is adjusted to a neutral pH, about pH 7.0, by adding lime or other alkaline chemicals such as soda ash or sodium hydroxide.

Fluoridation

Water fluoridation is the adjustment of fluoride in drinking water to a level that helps protect teeth against dental decay. We fluoridate five water supply systems that deliver fluoridated water to 12 localities within our service region. Fluoridation of the drinking water supplies is undertaken as per the requirements of the *Health (Fluoridation) Act 1973*.

Powdered Activated Carbon (PAC)

PAC is derived from a variety of sources such as coal, wood and coconut. Due to its high adsorption capacity, i.e., ability to attract contaminants and bind them to its surface, PAC is used to assist in removing taste & odour compounds, BGA toxins, and other impurities from water.

Manganese Treatment

We use Calgon-T for manganese treatment, which is a sequestering agent that prevents the oxidation of manganese in the treated water and eliminates water discolouration.

Table 2 - LMW Drinking Water Treatment Processes

Water Plant	Treatment	Water Locality	Supply	Treatment Process	Added Substances
Kerang		Kerang		- Coagulation - Flocculation - Sedimentation - Granular Media Filtration - Chlorine Disinfection - Fluoridation - UV Disinfection	- Aluminium Sulphate - Hydrated Lime - Sodium Hydroxide - Chlorine Gas - PAC - Fluorosilicic Acid - Calgon T
Koondrook		Koondrook		- Coagulation - Flocculation - Sedimentation - Granular Media Filtration - Chlorination - UV Disinfection	- Aluminium Sulphate - Sodium Hydroxide - Chlorine Gas - PAC - Calgon T
Mildura 7th Street Mildura West ¹		Mildura Merbein Irymple		- Coagulation - Flocculation - Sedimentation - Clarification - Granular Media Filtration - Granular Activated Carbon² - UV Disinfection - Chlorination - Fluoridation	- Aluminium Sulphate - Aluminium Chlorohydrate - Hydrated Lime³ - Polymer - Chlorine Gas - PAC - Fluorosilicic Acid - Sodium Metabisulfite - Sodium Hydroxide - Calgon T
Murrabit		Murrabit		- Coagulation - Flocculation - Sedimentation - Granular Media Filtration - Chlorination - UV Disinfection	- Aluminium Chlorohydrate - Sodium Hydroxide - Chlorine Gas - PAC - Calgon T
Piangil		Piangil		- Coagulation - Flocculation - Sedimentation - Granular Media Filtration - Chlorination - UV Disinfection	- Aluminium Chlorohydrate - Sodium Hydroxide - Chlorine Gas - PAC - Calgon T
Red Cliffs		Red Cliffs		- Coagulation - Flocculation - Pre-sedimentation - Dissolved Air Flotation - Granular Media Filtration - Chlorination - Fluoridation - UV Disinfection	- Aluminium Sulphate - Sodium Hydroxide - Chlorine Gas - PAC - Fluorosilicic Acid - Calgon T
Robinvale		Robinvale		- Coagulation - Flocculation - Clarification - Granular Media Filtration - Chlorination - Fluoridation - UV Disinfection	- Aluminium Sulphate - Soda Ash - Chlorine Gas - PAC - Sodium Fluoride - Polymer - Calgon T
Swan Hill		Swan Hill		- Coagulation - Flocculation - Clarification - Granular Media Filtration - UV Disinfection - Chlorination - Fluoridation	- Aluminium Chlorohydrate - Polymer - Sodium Hydroxide - Chlorine Gas - PAC - Fluorosilicic Acid - Calgon T

¹ Mildura West can utilise either Aluminium Sulphate or Aluminium Chlorohydrate.

² Applies to Mildura West

³ Applies to Mildura 7th Street

Drinking Water Quality Management

Quality Management Systems

LMW's DWQMP has been developed based on the 12 elements of the 'Framework for Management of Drinking Water Quality', described in the Guidelines and the requirements set out in the Act. The plan identifies key water quality risks in the water supply system using a catchment to tap approach. Each key risk is assessed, and critical control points are put in place to manage those risks to provide safe drinking water to our customers.

Verification of Water Quality Monitoring

Water quality monitoring constitutes a significant part of our water supply activities. We have a water quality monitoring program that was designed based on the requirements of the Regulations, and the Guidelines, including consideration of locality population numbers for bacterial monitoring.

Using the outcomes of the sanitary survey to assist in identifying the source water quality hazards and risks, we reviewed the irrigation practices within our catchment area to identify raw water quality parameters that potentially constitute health risks, and therefore, require ongoing monitoring.

The Guidelines provide a basis for assessing the quality of drinking water. The microbiological assessment is based on *E. coli*, which is considered a definitive indicator for the presence of faecal contamination, and therefore, a health risk. In terms of the physical and chemical monitoring, it is based on a combination of parameters that indicate the physical and aesthetic characteristics of water such as pH, colour and turbidity, as well as the chemical quality of the water, which include but not limited to free chlorine, iron and manganese, fluoride, dissolved salts, aluminium, copper, lead, chromium, nickel and other parameters.

To comply with the water quality monitoring requirements set out in the Act and Regulations, we use an external National Association of Testing Authorities (NATA) registered laboratory to perform all regulatory drinking water testing, which was developed based on a rigorous risk assessment process. All drinking water quality test results for 2024/25 are available in Appendix A.

In 2024/25 we collected around 4,000 samples from 16 water supply localities and analysed these for more than 40 parameters to assess water quality and safety.

Sampling Points

The water quality sampling points have been carefully chosen based on the DH 'Water Monitoring Program guidance', and risk assessment approach with the objective of identifying effective strategies for prevention and control of hazards within the distribution system.

This involved understanding the characteristics of the drinking water system, what hazards may arise, how these hazards create risks, and the processes and practices that affect drinking water quality.

While the sampling points are representative of the water quality within their subsequent supply systems, a regular review of the sampling points is undertaken to verify the locations of the current sampling points, ensure that they reflect the associated water quality risks within their distribution systems, and assess the need to add in additional sampling points to reflect the expansion of the water supply localities that results from population growth, i.e., new subdivisions.

Emergency Incident and Event Management

Section 18 and 22 Notifications

Section 22 of the Act requires an officer of a water supplier to notify the DH where it's suspected that the drinking water supplied, or to be supplied to customers, may pose a risk to human health, or cause widespread public complaint. LMW reported one instance of known or suspected contamination as required under Section 22 of the Act.

Section 18 of the Act require water suppliers to notify the Secretary of DH if it becomes aware that the drinking water supplied, or to be supplied, to another person does not comply, or is not likely to comply, with any relevant water quality standard and must do so within 10 days after it becomes aware of that fact. There was one incident that required reporting under Section 18 of the Act.

Reportable Incidents 2024-25

During 2024/25 the drinking water supplied to our customers was of high standard, except as described below.

There was one *E. coli* sample result that was non-compliant with the Schedule 2 standard. The non-compliant result was from a single sample collected at the storage tank located in Nyah Water Sampling Locality. In this case adequate chlorine residual were confirmed when the detections were recorded and the network. The relevant WTP was operating as expected. The tanks were inspected, and no ingress points identified. Follow-up sampling was completed, and the results confirmed that the water that was supplied was safe. Investigations were conducted into potential sources of contamination. However no obvious contamination sources were identified. Section 18 and 22 notification was completed for the *E.coli* non-compliance.

Issues

During 2024/25 the drinking water supplied to our customers was of high standard, except as described below.

Schedule 2 of Victoria's Safe Drinking Water Regulations 2015 (SDWR) list three specific drinking water quality standards that apply to all drinking water supplies in Victoria: *E. coli*, total trihalomethanes (THMs) and turbidity, all of which have mandated limits, and frequencies for sampling and testing.

During 2024/25, there was one *E. coli* sample result that was non-compliant with the Schedule 2 standard. The storage tank was inspected, and no ingress points were identified. There was adequate chlorine residual present and the water supplied did not pose a risk to human health.

Three-Year Percentage Compliance


A comparison of test results of water samples collected in accordance with the sampling program set out in our DWQMP, and percentage of complying samples over the last three financial years, based on the regulated parameters stipulated in the Regulations, was undertaken.

The high quality of the drinking water we supplied continued for 2024/25, except for one non-compliant *E. coli* result.

Figure 2 presents a summary of water quality performance against the standards specified in Schedule 2 of the Regulations. The data demonstrates full compliance across the majority of parameters, with one exception that was investigated and not found to pose any risk to human health.

Further detailed comparisons of water quality parameters with the previous two financial years are provided in the drinking water quality test results in Appendix A.

Figure 2 - Compliance with Water Quality Standards

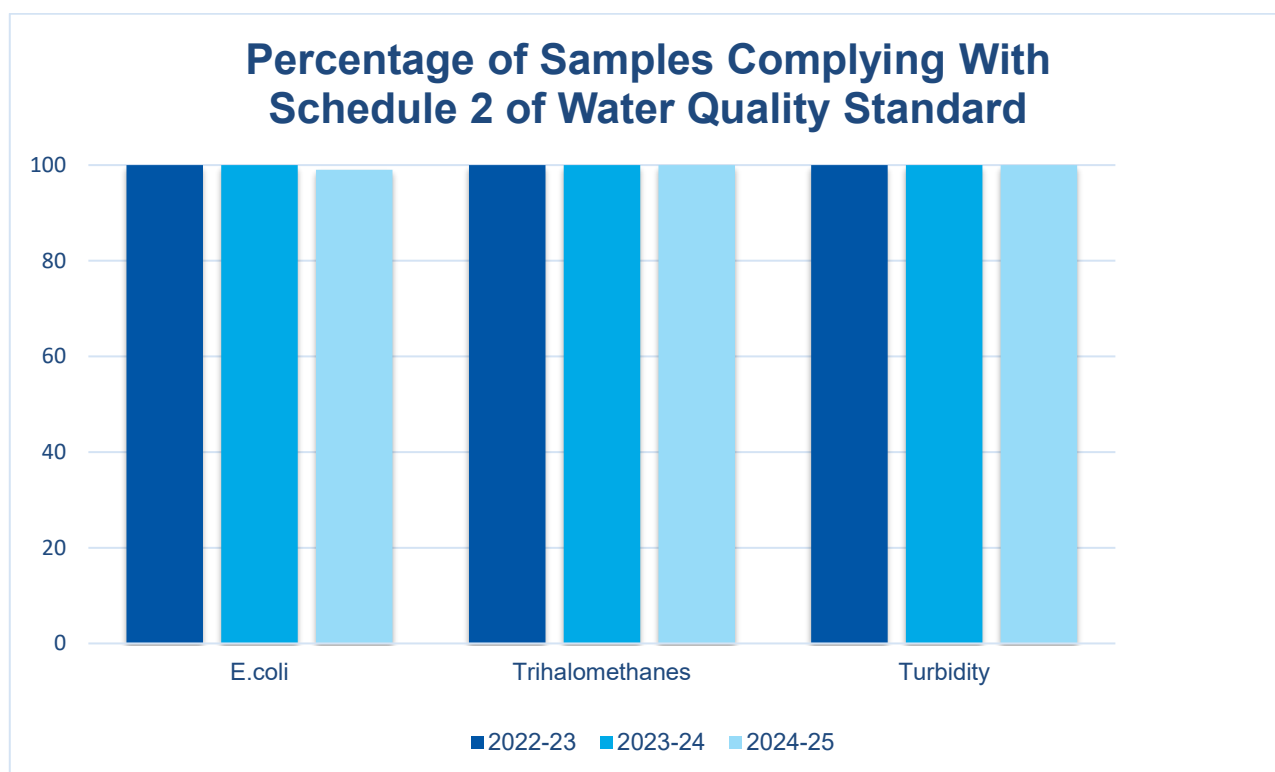


Fluoride Treatment

Levels of fluoride have remained consistently below the maximums specified in the ADWG over the three-year period.

During the reporting period, the rolling annual fluoride concentration of drinking water was within the operating range of 0.7 to 0.9 mg/L, as recommended by DH to provide a dental health benefit which was achieved within all water supply systems.

Figure 3 – Annual average fluoride concentration in drinking water

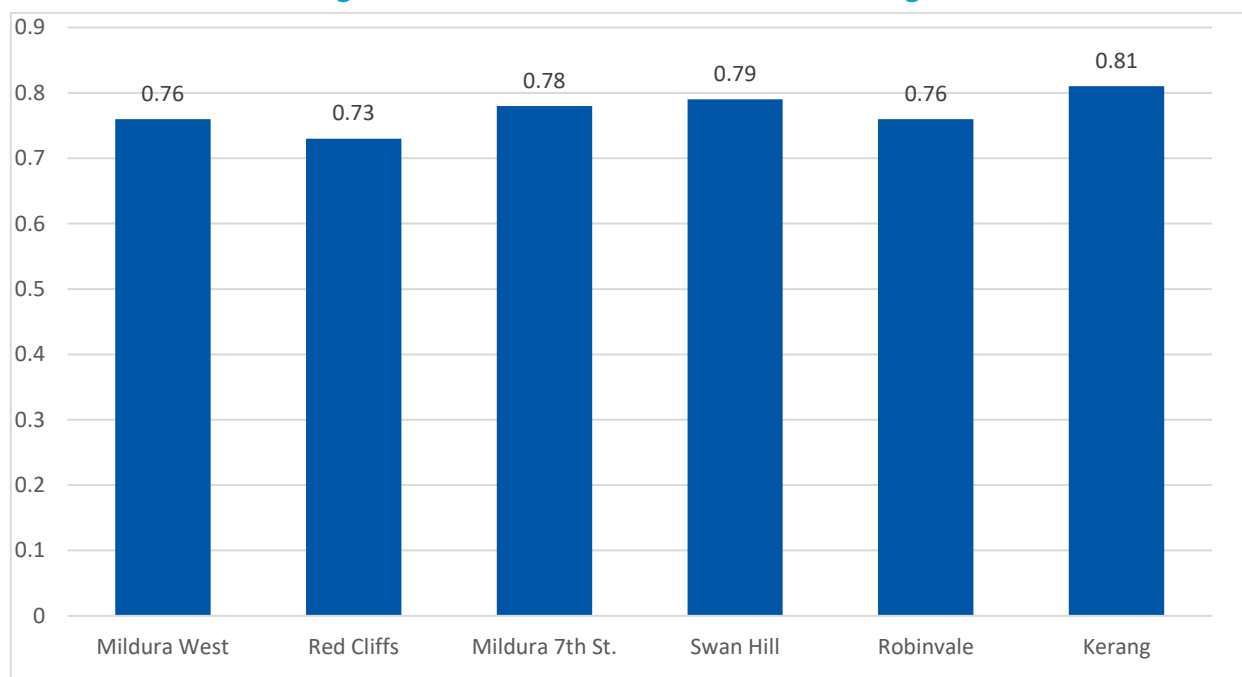

LMW's water quality sampling program indicates that all localities that receive fluoridated water supply were compliant for fluoride for the reporting period. Comprehensive data is provided in Table 4 of Appendix A.

Fluoride Outage Notifications

LMW notified DH of a total of three fluoride interruptions, where fluoride concentration in drinking water supplied was less than 0.6 mg/L for a continuous period of > 72 hours, as required under the Code of Practice for Fluoridation of Drinking Water Supplies (Vic).

These occasions occurred when fluoridation was taken offline as a precautionary measure while LMW undertook maintenance. A summary of interruptions is provided in Table 3.

Aesthetic Characteristics

LMW's water quality sampling program included aesthetic drinking water parameters turbidity, salinity, hardness, pH and colour. These results are reported in detail in Appendix A.

Table 3 – Summary of Fluoride Interruption

Fluoridation Plant	Interruption Date	Resumption Date	Summary	Number of Days Fluoride was Off-line
Mildura 7th St WTP	06/02/2025	11/02/2025	The fluoride dosing system was taken offline due to a leak in the dosing line.	6
Mildura West WTP	14/02/2025	19/02/2025	The fluoride dosing system was taken offline due to flow discrepancies shown by flowmeter leading to a high alarm.	6
Robinvale WTP	7/03/2025	14/03/2025	Fluoride dosing system was taken offline due to Fluorodose supply issues	8
Red Cliffs WTP	14/06/2025	24/06/2025	Dosing system was offline due to blockage of dosing pumps	11

Water quality and safety improvement initiatives

During the 2024/2025 financial year, LMW completed or continued several projects that contribute to maintaining and improving the robustness of the water treatment process and ensuring that water quality and safety were not compromised.

After a successful installation and commissioning of UV disinfection systems at Red Cliffs, Piangil, Koondrook, Kerang, Robinvale, Mildura West and Murrabit WTPs from 2019 onwards, LMW continues its endeavour to improve the robustness of the water supply systems. This includes completing our project to retrofit the Mildura 7th Street and Swan Hill WTPs with UV disinfection systems.

UV disinfection systems provide a secondary barrier for pathogenic microorganisms such as Cryptosporidium and Giardia, reduce risks to water safety especially during poor raw water quality events such as blackwater and BGA blooms, and ensure the delivery of safe drinking water during such events.

Table 4 lists the water quality and safety improvement projects that were initiated or completed in 2024/25.

Table 4 – Water quality and safety improvement projects

Water Treatment Plant (WTP)	Project	Project Status (Completed, In Progress, Planning)	Expenditure, \$ Actual FY 2024/25
All Sites	Instrument Replacement	In Progress	98,457.66
Swan Hill WTP	UV Treatment Upgrade	Completed	2,171,398.00
Mildura 7th St WTP	UV Treatment Upgrade	Completed	2,838,594.55
Mildura 7th St WTP	Clarifier Gearbox Replacement	In Progress	67,585.00
Robinvale WTP	Fluoride Dosing Board	In Progress	28,813.00
Mildura 7th St WTP	Fluoride Upgrade	In Progress	2,630.00
Mildura 7th St WTP	Merbein Booster Pump Station	In Progress	93,203.00
Mildura West WTP	Fluoride Upgrade	In Progress	58,289.00
Mildura	MDA - Reline 10th St Tower Drain Line	Completed	19,997.00
Mildura 7th St WTP	Filter Gallery Transfer Pipe	In Progress	58,257.00
Mildura 7th St WTP	Backwash Balance Tank	In Progress	178,847.00
Mildura 7th St WTP	Filter No.1, 2, 3 & 4 media replacement	In Progress	750,000
Mildura West WTP	Filter media replacement	In Progress	622,000.00
Swan Hill WTP	PAC pump upgrade	Completed	12,720.00
Swan Hill WTP	Sludge balance tank	Completed	280,000.00
Kerang	Main Replacement Victoria St Btw Scoresby & Wellington Install 250m of DN150	Completed	127,706.00
Kerang	Elevated Tower Refurbishment	Completed	696,000.00
Kerang WTP	PAC pump upgrade	Completed	8126.00
Kerang WTP	Replace backwash pumps	Completed	23,524.00
Piangil WTP	PAC pump upgrade	Completed	15.594.00

Staff Training

LMW always endeavour to ensure that treatment plants' operators have achieved Certificate III qualifications in water industry operations. Whilst some operators have already completed this training, others are progressing towards achieving Certificate III, and new members who have recently joined the operational team have been enrolled in this training program.

In addition, LMW's treatment plant operators attend the Water Industry Operators Association (WIOA) conference in Bendigo on annual basis and visit other water authorities WTPs when the opportunity arises. In this reporting period, two of LMW's treatment plant operators attended WIOA Network Operator Development Program to network and share the knowledge gained through their practical experience. We also engage instruments suppliers to conduct training on the operation and maintenance of the instruments.

Drinking Water Quality Standards

During 2024/25 financial year, LMW remained 100% compliant with the water quality standards specified for drinking water in Schedule 2 of the Regulations. These are outlined in Table 5. All drinking water quality results can be found in Appendix A of this report.

Table 5 - Schedule 2 Safe Drinking Water Regulations 2015 Drinking Water Quality Standards

Parameter	Sampling Frequency	Quality Standards
E. coli	One sample per week	No <i>E. coli</i> per 100 millilitres of drinking water, with the exception of any false positive sample.
Total Trihalomethanes	One sample per month	Less than or equal to 0.25 mg/L of drinking water.
Turbidity	One sample per week	The 95th percentile of results for samples in any 12-month period must be $\leq$ to 5.0 NTU.

Other Water Quality Standards

In addition to the water quality parameters stipulated in the Regulations, we also monitored a range of other parameters, such as substances that may pose a risk to human health, to compare against ADWG health-related guideline values and ensure the safety and quality of the drinking water.

Table 6 lists other parameters included in the water quality parameters list, that are regularly monitored in drinking water samples collected from the reticulation system and water storages.

LMW has assessed the test results of these parameters against the ADWG health-related guideline values and found all results were fully compliant.

BGA

BGA (Cyanobacteria) are microscopic organisms that may thrive in warm, nutrient rich waters. They may impact water quality by releasing taste and odour compounds. In some extreme circumstances, these organisms may release concentrations of toxins.

As part of our water quality monitoring program, raw water samples are collected on a weekly basis from source water during the BGA season (November to May inclusive) and tested in-house for BGA cell count.

The BGA monitoring frequency increases to twice weekly if:

- $2,000 \leq \text{Cell numbers} < 6,500 \text{ Cells/mL}$ *Microcystis aeruginosa*, or
- $0.2 \leq \text{Total biovolume} < 0.6 \text{ mm}^3/\text{L}$

BGA blooms in drinking water supplies that may pose a risk to public health or may result in widespread public complaint, for example through taste and odour issues, must be notified to the DH using the notification arrangements under Section 22 of the Act.

Water supplied for drinking may place public health at risk due to one or more of the following:

- Total microcystins are detected at $\geq 1.3 \mu\text{g/L}$ (Microcystin-LR toxicity equivalents).
 - *Microcystis aeruginosa* is present at $\geq 6,500 \text{ cells/mL}$
 - Total combined biovolume of known toxic cyanobacterial species $\geq 0.6 \text{ mm}^3/\text{L}$
 - Total combined biovolume of all cyanobacterial species $\geq 10 \text{ mm}^3/\text{L}$
- or
- BGA is present in drinking water at levels that may cause widespread public complaint, for example through taste and odour.

Table 6 – Other drinking water quality standards

Parameter	ADWG 2011 Guideline (mg/L)		Frequency of testing	Met the guideline Yes/No
	Health	Aesthetic		
Arsenic	0.01		Quarterly	Yes
Cadmium	0.002		Quarterly	Yes
Chlorine	5	0.6	Weekly	Yes
Chromium	0.05		Quarterly	Yes
Copper	2	1	Quarterly	Yes
Cyanide	0.08		Quarterly	Yes
Fluoride	1.5		Weekly	Yes
Lead	0.01		Quarterly	Yes
Manganese	0.5	0.1	Quarterly	Yes
Mercury	0.001		Quarterly	Yes
Nitrate	50		Quarterly	Yes
Iron	c	0.3	Quarterly	Yes
Zinc	c	3	Quarterly	Yes
Selenium	0.01		Quarterly	Yes
Nickel	0.02		Quarterly	Yes
Sulphate	c	250	Quarterly	Yes
Atrazine	0.02		Yearly	Yes
Chlorpyrifos	0.01		Yearly	Yes
Chlorothalonil	0.05		Yearly	Yes
Glyphosate	1		Yearly	Yes
Maldison (Malathion)	0.07		Yearly	Yes
Simazine	0.02		Yearly	Yes
Gross Alpha			Every 5 years	Yes
Gross Beta			Every 5 years	Yes

c ADWG 2011 note that there is insufficient data to set a guideline value based on health conditions

Water Quality Complaints

LMW is committed to providing high quality, safe drinking water and continuously improving services and communications to all customers. To ensure water quality complaints are resolved in appropriate timeframes, complaints are captured in LMW's customer management system 'MERIT', which provides workflow tracking of each complaint from registration to completion. MERIT directs the complaint to the relevant action officer to follow up with the customer. Complaints received after hours via our 1800 phone number are also directed to the relevant officer the next working day for follow up, if necessary.

If the issue cannot be resolved over the phone, an officer attends the property of concern to discuss the complaint with the customer, undertakes basic water quality testing such as pH, turbidity and colour, and takes water samples for taste tasting. Main's flushing will be undertaken, if necessary.

Monthly complaint summary reports for Board meetings, and quarterly reports for Essential Services Commission reporting are prepared from the MERIT database.

2024/25 Complaints Data

A total of 104 water quality complaints from a customer base of 77,137 equivalent to 0.137 complaints per 100 customers was recorded in 2024/25. This is a noticeable decrease from 2023/24 where 128 water quality complaints were recorded, which equates to 0.166 water quality complaints per 100 customers.

Over the reporting period, the main water quality complaint was for discoloured water (74 complaints). Discoloured water can be attributed to one or a combination of several factors which could include a burst water main within the area, change in the direction of water flow that could result in scouring of the water mains, manganese, iron or potentially from a customer's internal plumbing or hot water service. The colour complaints account for 71% of the total number of complaints received throughout the reporting period.

LMW systematically undertake mains cleaning programs that assist in maintaining and improving water quality, consequently reducing the number of water quality complaints. Reactive mains flushing is conducted in response to customer requests to investigate water quality issues associated with colour, taste and/or odour complaints.

We monitor BGA during the spring and summer season, where algae growth is accelerated due to the warm weather conditions. In general, we promote biological growth within the filter media, as it helps break down the taste and odour compounds. During algal blooms, we undertake additional treatment measures involving dosing of PAC at WTPs to help remove taste and odour compounds.

The second highest number of complaints were for taste and odour (29 complaints), which can be generated by one or more factors including but not limited to the presence of BGA, soluble organics, elevated chlorine residual, etc. Algal blooms can result in the presence of taste and odour compounds such as geosmin and MIB. Reduced water consumption and extended retention times during low flows in the reticulation system 'long age' and dead ends may also contribute to imparting taste and odour to the water.

LMW received two alleged illness complaints during the reporting period. The alleged illness complaints were thoroughly investigated and were found not related to the quality of water supplied.

Tables 7A and 7B show a comparison between the number of water quality complaints received during 2024/25, to those of the previous year, and the types of complaints received by each of LMW's water sampling locality respectively.

Table 7C shows the types of water quality complaints, total water quality complaints received during 2024/25, and the number of complaints per 100 customers supplied.

Table 7A – Types of complaints compared to previous reporting periods

Type of Complaints	Number of Complaints	Comparison with previous reporting periods			Comments
	24/25	23/24	22/23		
Colour	74	62	52	An increase by twelve complaints	
Taste and odour	26	49	19	Decreased by twenty-three complaints	The decrease is due to taste and odour compounds below threshold limits.
Blue water	0	0	0	No Change	No complaints received.
Alleged sickness	3	7	3	Decreased by four complaints	The alleged sickness complaints were investigated thoroughly and found not to be attributed to the quality of the water supplied.
Other	1	10	5	Decreased by nine complaints	
Total	104	128	79	Decreased by 14 complaints	

Table 7B – Types of complaints by water sampling locality

Water sampling locality	Type of complaints					
	Colour	Taste and odour	Blue water	Alleged sickness	Other	Total complaints
Irymple	5	4	0	2	0	9
Kerang	7	3	0	0	0	10
Koondrook	0	0	0	0	0	0
Lake Boga	1	1	0	0	0	2
Merbein	5	0	0	0	0	5
Mildura	44	14	0	0	2	60
Murrabit	0	0	0	0	0	0
Nyah	0	0	0	0	0	0
Nyah West	1	0	0	0	0	1
Piangil	0	0	0	0	0	0
Red Cliffs	5	0	0	0	0	5
Robinvale	1	0	0	0	0	1
Swan Hill	4	3	0	0	0	7
Woorinen	1	1	0	0	0	2
Total	74	26	0	2	2	104

Table 7C – Water Quality Complaints by the type of complaints

TYPE of complaints	No. of complaints	No. of complaints per 100 customers supplied	LMW's Corporate Target
Colour	74	0.097	
Taste and odour	26	0.034	
Alleged sickness	2	0.000	
Blue water	0	0.003	
Other	2	0.003	
Total	104	0.137	< 25 Complaints

Risk Management Plan Audit Results

Audit Process

During the reporting period, LMW was not required to undertake an external audit of its risk management plan pursuant to the Act. In response to the following eighteen opportunities for improvements (OFI's) identified in the previous Safe Drinking Water Act audit conducted for the period 01 January 2021 to 31 December 2022 inclusive. LMW have undertaken necessary actions to address the OFI as per below:

Table 8 – Status of 2021-2022 Risk Management Plan OFIs

Opportunity for Improvement	Lower Murray Water Response	Status
Red Cliffs Water Supply System		
A printout of the instrument and calibration and operation manual was observed at the plant, dated September 2016 and may not be the latest version or relate to the current instruments at the plant. There may be a more up to date one available on the LMW Intranet. If so, it is recommended that it be printed out and saved in the folder in the lab at the plant. If not, it is recommended that the manual be reviewed and updated with the latest instruments if necessary.	A new copy was printed and displayed at site and outdated copy disposed of.	Complete
Koondrook WTP and supply system		
The current jar testing equipment at the plant is not fully functional. The team uses the jar testing equipment regularly, especially during rapid changes in water quality. It is recommended that the plant be provided with an operational jar tester.	A new jar tester arrived shortly after the audit.	Complete
At times the backwash water flowrate exceeds the capacity of the overflow pipework that allows these flows to be diverted to sewer. It is recommended that the system design be reviewed, and consideration given to installing a larger diameter overflow pipe from the backwash recovery tank	All viable options are being considered	Due by June 2026
Murrabit WTP and supply system		
It is recommended that LMW consider ways to enclose the sedimentation area, to prevent bird droppings from birds roosting in the roof above. Coagulation is one of the pathogen treatment barriers and compromising this barrier could pose a risk to water quality.	The shed has been covered with green cloth and waiting for the install	Closed
There are 4 treated water storages at this site, however only 3 are shown on the SCADA. It is recommended that the SCADA be updated to match the plant configuration.	SCADA page has been updated to reflect the actual plant configuration in September 2024.	Complete
Millewa WQP and supply system		

Opportunity for Improvement	Lower Murray Water Response	Status
Records team are in the process of developing reporting tools so that the team are made aware of what documents are due for review. It is recommended that once the Records team sets up this system, the documents that require review be prioritised and updated		
The team advised that there are sites that were not part of the audit scope where the chemical storage volumes could be increased (e.g. 7th Street) and this would be worthwhile to assess what would be required and the associated costs, land availability requirements, etc given there is less certainty in supply than previously	The quotation process has begun as part of major capex, with the view to increase chemical storage capacity at Mildura WTP. LMW is in the process of prioritising the projects for Water Plan 6. The timeframe for the project will be in Water Plan 6.	Closed
Murrabit and Koondrook WTPs include the provision of “filter to waste” in their design. The LMW team advised that this facility is not available at Mildura, Kerang and Red Cliffs WTPs. It would be beneficial to incorporate this functionality at these plants. It is recommended that LMW assess the options, costs and practicality of implementing “filter to waste” at these plants	Filter to Waste has been budgeted and scheduled for Red Cliffs under the current Master Capital Works Program for Red Cliffs. Mildura is scheduled for 2028/29. This is a major project; possible timeframe will be Sep 2026 for Red Cliffs and 2028/29 for Mildura	Closed
LMW is implementing a new system to visualise Health Based Target (HBT) compliance (KDX Vantage) that utilises data from SCADA. It is recommended that LMW investigate a data management solution for other operational information organise and collected by the team including external laboratory data, internal laboratory data, instrument calibration records, field inspection records, prepare regular reports. This system would reduce the likelihood of errors, be more efficient than the current process of manually managing data and preparing reports, have the ability to promptly identify non-compliances, etc	Currently an internal Database is under use. A data management solution is being considered as part of the Business BTP	Complete
There would also be benefit in providing training to a broader team at LMW (e.g. staff who receive calls from the community, network operations and maintenance team members, etc) on the ADWG covering much of the content in the National Water Training Package Unit of Competency - GEN017 - - Apply the risk management principles of the water industry standards, guidelines and legislation and this is recommended for LMW consider.	Planning is underway to develop training packages specific to the AWDG. All viable options are being considered.	Due by June 2026
Consider whether it would be worthwhile having a specific line item in the EMP – Table 3.3.4 Recognition Table – Determining the Level of Event/Response to cover water quality (e.g. what level of incident corresponds to issuing a boil water notice) to assist with determining the level of response required	This OFI has being incorporated into a larger EMP revision.	Closed

Opportunity for Improvement	Lower Murray Water Response	Status
It would be more efficient and effective to have an internal process engineering resource to assist the operations and maintenance team, especially during and after flood/blackwater events. They would be able to implement actions raised and lessons learned from these events so that the team is better prepared with more robust processes to more effectively manage future events. Additionally, there is a significant number of equipment and other plant faults identified by the team, and the team could benefit from this additional process engineering resource. This resource could support with root cause analysis and continuous improvement work, resulting in reduced the risk of water quality incidents and make the water supply systems more robust.	A change to LMW Operating model has brought Treatment Operations and Water Quality under the same Manager - Manager Water Quality & Environment. This has improved decision making about plant faults, process changes and will incorporate lessons learnt from past water quality issues into a common review process. A new resource (chemical engineer) has also been employed to validate and streamline decision making in the water quality team. Improvement in the planning processes, regular inspections along with Lessons Learnt are expected to reduce the risk of water quality incidents	Completed
The water quality team is responsible for ensuring that the necessary systems and processes are in place to provide safe drinking water. It is recommended that LMW consider providing an additional resource in this team. The role would assist with progressing a number of the OFI's identified in this audit, provide water quality data review support and backup, help to keep documentation up to date, provide mentoring and refresher training for field teams, conduct internal audits, provide a backup for sampling, etc.	An additional resource has been added to the Water Quality Team Structure. A Trade Waste and Backflow Operator is expected to review water quality data, provide support and fill the current gaps in data, training and general duties. Recruitment has been initiated. This has been delayed to staff turnover.	Due by October 2026

Regulated Water

What is Regulated Water?

Section 6 of the Act allows the Minister for Health to declare any water that is not drinking water, but that may be supplied to the public in circumstances in which it may be mistaken as being drinking water, to be 'regulated water' for the purposes of the Act.

Following consultation between the DH and LMW, the Minister for Health declared the water supplied by LMW to the Millewa and Mystic Park water supply systems as regulated water under Section 6 of the Act.

The declaration for the Millewa system was gazetted in the Victoria Government Gazette Special Edition No. S28 on 15 February 2007 and the Mystic Park system was gazetted in the Victoria Government Gazette Special Edition No. S135 on 19 May 2009.

Declaration as regulated water meant that LMW had to prepare and implement risk management plans for the Millewa and Mystic Park water supply systems. This was to minimise the risk that the water as supplied could be mistaken for drinking water.

LMW takes all necessary steps to ensure that residents and visitors to Meringur, Werrimull, Cullulleraine in the Millewa Waterworks District and Mystic Park are aware that the mains water supply to these towns is untreated and not suitable for consumption. The following actions are undertaken:

- provide the 'Living with an Untreated Water Supply' brochure and reminder notices to LMW customers who are connected to an untreated water supply including private diverters, advising that untreated water is not suitable for drinking, teeth brushing or food preparation, and that due care should be taken when bathing and showering to avoid swallowing of untreated water.
- supply the 'Living with an Untreated Water Supply' brochure to accommodation facilities as requested to assist in informing guests that their supply is untreated and is not suitable for drinking, teeth brushing, or food preparation and that due care should be taken when bathing and showering to avoid swallowing of untreated water bathing.
- provide 'Do Not Drink' signs free of charge to the responsible managers of all publicly accessible taps connected to untreated water (parks, public toilets, schools, halls, caravan parks, etc.).
- provide notification via Information Statements of the property's untreated water supply to intending property purchasers.
- provide new irrigation or domestic and stock customers with an information kit including the 'Living with an Untreated Water Supply' brochure.
- make a copy of our customer charter available which details the respective rights and obligations of customers supplied with untreated water.
- Publish this information on our website.

LMW's Regulated Water Supplies

Millewa Water Supply System

- A non-potable water system supplies an area which includes the towns of Meringur, Werrimull and Cullulleraine and also the surrounding rural properties in the Millewa district. The water is sourced from Lake Cullulleraine which is filled directly from the Murray River via an earthen channel. The population served by this supply is estimated to be less than 300.
- The water supply system is primarily a domestic and stock water supply to dryland farmers in the Millewa area located to the west of Mildura. Previously, the water from Lake Cullulleraine had been chlorinated as it was pumped into the system to control the nuisance growth of the *Plumatella* species, which if allowed to become established within a pipeline system can cause severe ongoing operational challenges.

- In 2013, LMW commissioned a Water Quality Plant at Lake Cullulleraine. The plant has improved water quality; providing clearer water for domestic uses such as washing, and farmers can benefit as the impact of clogging on their spraying equipment is reduced.
- The treatment plant comprises two large lagoons that alternate as storages for removing turbidity. Aluminium sulphate is used to aid in the precipitation of the suspended matter. Clarified water is chlorinated whilst gravitating into a clear water storage tank from which it is pumped into the Bambill water storage dam or into the Cullulleraine reticulation system.
- The 182 ML storage dam at Bambill is an earthen water storage within the Millewa system, located at Bambill South which supplies operating head for the system when the treated water pumps are not operating.
- The dryland area serviced by the Millewa regulated water supply covers an area of approximately 243,500 hectares. The total number of connections for the supply to the dryland farming properties is 252. Biennial audit of Millewa Regulated Water Supply was completed in June 2024.

Mystic Park Water Supply System

A non-potable water system supplies the small township of Mystic Park which is located to the south of Swan Hill. In May 2008, LMW assumed responsibility for the Mystic Park untreated water supply, previously the responsibility of the Gannawarra Shire Council.

The water is sourced from nearby Kangaroo Lake before being screened and pumped to an earthen dam located within the township. A small amount of coagulant is added as the water enters the dam. This dam provides some detention time assisting in the reduction of turbidity in the water; however, no disinfection is provided.

The town population is currently 29 with 12 serviced properties, including a hotel, recreation reserve and cenotaph. Biennial audits for Mystic Park Regulated supplies were completed in June 2024.

APPENDIX A – Water Quality Tables

All samples were taken from within the reticulation network unless mentioned otherwise.

Tables 1 to 3 and 42 contain results reporting against the standards listed in Schedule 2 of the Safe Drinking Water Regulations 2015.

Tables 4 to 38 inclusive, are results reporting against health & aesthetic guidelines set in ADWG.

Tables 9 to 20 & 34 to 41 inclusive, are parameters from samples taken from LMW's 9 WTPs entering the reticulation system, 8 localities in total (Mildura & Mildura West have a combined locality, Mildura). This differs from other parameters, which show 14 localities that are supplied from a total of 9 treatment plants.

Tables 9 to 16 inclusive, which have biannual scheduling, have 3 samples reported for Mildura this financial year instead of 4 for Mildura, as Mildura West WTP was offline in the last quarter of reporting period.

Tables 17 to 20 and 35 to 41 inclusive, which have quarterly scheduling, have seven samples reported instead of eight for Mildura, as Mildura West WTP was offline in the last quarter of reporting period.

Tables 5, 9 to 16, 18, 19 - 24, 27 - 29 & 34 inclusive, do not have averages as the average cannot be calculated from 'less than' data.

Table 1 Escherichia coli (*E. coli*)

E. coli is a microorganism associated with potential contamination of water supplies with faecal material.

Drinking Water Quality Standard: All samples of drinking water collected must contain no Escherichia coli per 100 millilitres of drinking water, with exception of any false positive sample.

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum detected (CFU/100mL)	Number of detections and investigations conducted (s.22)	Number of samples where standard was not met (s.18)
Irymple	Weekly	52	0	0	0
Kerang	Weekly	52	0	0	0
Koondrook	Weekly	52	0	0	0
Lake Boga	Weekly	52	0	0	0
Merbein	Weekly	53	0	0	0
Mildura ¹	Weekly	118	0	0	0
Murrabit	Weekly	52	0	0	0
Nyah	Weekly	52	0	0	0
Nyah West	Weekly	52	0	0	0
Piangil	Weekly	52	0	0	0
Red Cliffs	Weekly	52	0	0	0
Robinvale	Weekly	52	0	0	0
Swan Hill ¹	Weekly	80	0	0	0
Woorinen South	Weekly	52	0	0	0

¹ Mildura and Swan Hill had more reticulation samples collected and analysed due to large populations served by these supplies.

Table 2 Trihalomethanes (THMs)

THMs are by-products of reaction between chlorine disinfectant and organic material present in water. These compounds can pose a threat to public health if present in drinking water in high concentrations over extended periods of time.

Water Quality Standard: Total Trihalomethanes must be less than or equal to 0.25 milligrams per litre of drinking water.

Water Sampling Locality	Frequency of Sampling	Number of Samples	Drinking water quality standard (mg/L)	Maximum (mg/L)	Average (mg/L)	Number of samples where standard was not met (s.18)
Irymple	Monthly	12	0.25	0.044	0.032	0
Kerang	Monthly	12	0.25	0.042	0.024	0
Koondrook	Monthly	12	0.25	0.055	0.034	0
Lake Boga	Monthly	12	0.25	0.055	0.041	0
Merbein	Monthly	12	0.25	0.076	0.046	0
Mildura	Monthly	12	0.25	0.051	0.031	0
Murrabit	Monthly	12	0.25	0.042	0.028	0
Nyah	Monthly	12	0.25	0.081	0.058	0
Nyah West	Monthly	12	0.25	0.076	0.051	0
Piangil	Monthly	12	0.25	0.073	0.038	0
Red Cliffs	Monthly	12	0.25	0.056	0.040	0
Robinvale	Monthly	12	0.25	0.040	0.029	0
Swan Hill	Monthly	12	0.25	0.052	0.027	0
Woorinen South	Monthly	12	0.25	0.081	0.050	0

Table 3 Turbidity

Turbidity is an indirect indicator for the overall quality of water and may represent fine particles such as clays, minerals or microscopic organisms.

Water Quality Standard: The 95th percentile of results for samples in any 12-month period must be less than or equal to 5.0 Nephelometric Turbidity Units (NTU).

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum turbidity in a sample (NTU)	Maximum 95 th percentile of turbidity results in any 12 months (NTU)	Number of 95 th percentile of results in any 12 months above standard (s.18)
Irymple	Weekly	52	4.4	0.5	0
Kerang	Weekly	52	1.8	0.8	0
Koondrook	Weekly	52	1.3	0.3	0
Lake Boga	Weekly	52	0.2	0.2	0
Merbein	Weekly	53	0.5	0.3	0
Mildura	Weekly	53	5.8	0.6	0
Murrabit	Weekly	52	0.2	0.2	0
Nyah	Weekly	52	0.5	0.1	0
Nyah West	Weekly	52	0.2	0.1	0
Piangil	Weekly	52	0.1	0.1	0
Red Cliffs	Weekly	52	0.8	0.3	0
Robinvale	Weekly	52	15	0.1	0
Swan Hill	Weekly	52	0.5	0.2	0
Woorinen South	Weekly	52	0.2	0.1	0

Table 4 Fluoride

Fluoride is added to the drinking water sampling localities listed below to promote oral health as directed by DH. Fluoride samples are taken monthly in each of the fluoridated water sampling localities. No fluoride data is available for Koondrook, Murrabit and Piangil systems as these systems do not have fluoridation.

Drinking Water Quality Standard: The total concentration of fluoride in drinking water should not exceed 1.5 mg/L.

Compliance: Annual average fluoride level must not exceed 1 milligram per litre and all individual samples must be less than 1.5 milligrams per litre fluoride concentrations under s.5 (3) of Health (Fluoridation) Act 1973.

Water Sampling Locality	Frequency of Sampling	Number of Samples	Drinking water quality standard (mg/L)	Target optimum operating fluoride concentration (mg/L)	Maximum (mg/L)	Average (mg/L)	Number of samples where standard was not met (s.18)
Irymple	Weekly	52	1.5	0.8	0.95	0.708	0
Kerang	Weekly	52	1.5	0.8	0.91	0.726	0
Lake Boga	Weekly	52	1.5	0.8	0.96	0.794	0
Merbein	Weekly	53	1.5	0.8	0.93	0.754	0
Mildura	Weekly	54	1.5	0.8	0.89	0.715	0
Nyah	Weekly	52	1.5	0.8	0.91	0.788	0
Nyah West	Weekly	52	1.5	0.8	0.95	0.788	0
Red Cliffs	Weekly	52	1.5	0.8	0.90	0.733	0
Robinvale	Weekly	52	1.5	0.8	0.97	0.703	0
Swan Hill	Weekly	52	1.5	0.8	0.95	0.793	0
Woorinen South	Weekly	52	1.5	0.8	0.95	0.797	0

Table 5 Chloroacetic Acid

Health Guideline Value (ADWG) 0.15 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Met ADWG guideline value (Yes/No)
Irymple	Monthly	12	<0.005	Yes
Kerang	Monthly	12	<0.005	Yes
Koondrook	Monthly	12	<0.005	Yes
Lake Boga	Monthly	12	<0.005	Yes
Merbein	Monthly	12	<0.005	Yes
Mildura	Monthly	12	<0.005	Yes
Murrabit	Monthly	12	<0.005	Yes
Nyah	Monthly	12	<0.005	Yes
Nyah West	Monthly	12	<0.005	Yes
Piangil	Monthly	12	<0.005	Yes
Red Cliffs	Monthly	12	<0.005	Yes
Robinvale	Monthly	12	<0.005	Yes
Swan Hill	Monthly	12	<0.005	Yes
Woorinen South	Monthly	12	<0.005	Yes

Table 6 Dichloroacetic Acid

Health Guideline Value (ADWG) 0.1 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Average (mg/L)	Average change Comparison of past reporting period	Met ADWG guideline value (Yes/No)
Irymple	Monthly	12	0.009	0.004	Declined	Yes
Kerang	Monthly	12	<0.03 ¹	0.007	Declined	Yes
Koondrook	Monthly	12	0.017	0.012	Declined	Yes
Lake Boga	Monthly	12	0.025	0.011	Increased	Yes
Merbein	Monthly	12	0.016	0.007	Remained the same	Yes
Mildura	Monthly	12	0.009	0.004	Declined	Yes
Murrabit	Monthly	12	<0.02 ¹	0.011	Remained	Yes
Nyah	Monthly	12	0.010	0.003	Declined	Yes
Nyah West	Monthly	12	<0.02	0.004	Remained	Yes
Piangil	Monthly	12	0.028	0.011	Declined	Yes
Red Cliffs	Monthly	12	0.016	0.006	Declined	Yes
Robinvale	Monthly	12	0.011	0.006	Declined	Yes
Swan Hill	Monthly	12	0.015	0.006	Increased	Yes
Woorinen South	Monthly	12	0.009	0.004	Increased	Yes

¹ Limit of Reporting increased due to interference

Table 7 Trichloroacetic Acid

Health Guideline Value (ADWG) 0.1 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Average (mg/L)	Average change Comparison of past reporting period	Met ADWG guideline value (Yes/No)
Irymple	Monthly	12	0.008	0.003	Decreased	Yes
Kerang	Monthly	12	0.009	0.004	Decreased	Yes
Koondrook	Monthly	12	0.019	0.012	Decreased	Yes
Lake Boga	Monthly	12	0.020	0.008	Remained the same	Yes
Merbein	Monthly	12	0.013	0.005	Decreased	Yes
Mildura	Monthly	12	0.007	0.003	Decreased	Yes
Murrabit	Monthly	12	0.019	0.011	Increased	Yes
Nyah	Monthly	12	0.020	0.010	Remained the same	Yes
Nyah West	Monthly	12	0.019	0.009	Remained the same	Yes
Piangil	Monthly	12	0.032	0.011	Decreased	Yes
Red Cliffs	Monthly	12	0.011	0.004	Decreased	Yes
Robinvale	Monthly	12	0.009	0.004	Decreased	Yes
Swan Hill	Monthly	12	0.016	0.005	Increased	Yes
Woorinen South	Monthly	12	0.018	0.008	Increased	Yes

Table 8 Aluminium

Aesthetic Guideline Value (ADWG) 0.2 mg/L (acid soluble)

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Average (mg/L)	Average change Comparison of past 2 reporting periods	Met ADWG guideline value (Yes/No)
Irymple	Monthly	12	0.38	0.062	Increased	No
Kerang	Monthly	12	0.13	0.018	Increased	Yes
Koondrook	Monthly	12	0.02	0.010	Decreased	Yes
Lake Boga	Monthly	12	0.04	0.021	Increased	Yes
Merbein	Monthly	12	0.02	0.016	Decreased	Yes
Mildura	Monthly	12	0.08	0.031	Decreased	Yes
Murrabit	Monthly	12	0.05	0.020	Increased	Yes
Nyah	Monthly	12	0.03	0.015	Increased	Yes
Nyah West	Monthly	12	0.03	0.016	Increased	Yes
Piangil	Monthly	12	0.04	0.019	Increased	Yes
Red Cliffs	Monthly	12	0.02	0.012	Decreased	Yes
Robinvale	Monthly	12	0.03	0.014	Decreased	Yes
Swan Hill	Monthly	12	0.03	0.015	Increased	Yes
Woorinen South	Monthly	12	0.03	0.015	Increased	Yes

Table 9 2,4 Dichlorophenoxy acetic acid – Entry Point

Health Guideline Value (ADWG) 0.03 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Met ADWG guideline value (Yes/No)
Kerang	6 Monthly	2	<0.01	Yes
Koondrook	6 Monthly	2	<0.01	Yes
Mildura	6 Monthly	3	<0.01	Yes
Murrabit	6 Monthly	2	<0.01	Yes
Piangil	6 Monthly	2	<0.01	Yes
Red Cliffs	6 Monthly	2	<0.01	Yes
Robinvale	6 Monthly	2	<0.01	Yes
Swan Hill	6 Monthly	2	<0.01	Yes

Table 10 Benzene – Entry point

Health Guideline Value (ADWG) 0.001 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Met ADWG guideline value (Yes/No)
Kerang	6 Monthly	2	<0.001	Yes
Koondrook	6 Monthly	2	<0.001	Yes
Mildura	6 Monthly	3	<0.001	Yes
Murrabit	6 Monthly	2	<0.001	Yes
Piangil	6 Monthly	2	<0.001	Yes
Red Cliffs	6 Monthly	2	<0.001	Yes
Robinvale	6 Monthly	2	<0.001	Yes
Swan Hill	6 Monthly	2	<0.001	Yes

Table 11 Carbon Tetrachloride – Entry Point

Health Guideline Value (ADWG) 0.003 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Met ADWG guideline value (Yes/No)
Kerang	6 Monthly	2	<0.001	Yes
Koondrook	6 Monthly	2	<0.001	Yes
Mildura	6 Monthly	3	<0.001	Yes
Murrabit	6 Monthly	2	<0.001	Yes
Piangil	6 Monthly	2	<0.001	Yes
Red Cliffs	6 Monthly	2	<0.001	Yes
Robinvale	6 Monthly	2	<0.001	Yes
Swan Hill	6 Monthly	2	<0.001	Yes

Table 12 1,2-dichloroethane - Entry Point

Health Guideline Value (ADWG) 0.003 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Met ADWG guideline value (Yes/No)
Kerang	6 Monthly	2	<0.001	Yes
Koondrook	6 Monthly	2	<0.001	Yes
Mildura	6 Monthly	3	<0.001	Yes
Murrabit	6 Monthly	2	<0.001	Yes
Piangil	6 Monthly	2	<0.001	Yes
Red Cliffs	6 Monthly	2	<0.001	Yes
Robinvale	6 Monthly	2	<0.001	Yes
Swan Hill	6 Monthly	2	<0.001	Yes

Table 13 1,1-dichloroethene – Entry Point

Health Guideline Value (ADWG) 0.03 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Met ADWG guideline value (Yes/No)
Kerang	6 Monthly	2	<0.0001	Yes
Koondrook	6 Monthly	2	<0.0001	Yes
Mildura	6 Monthly	3	<0.0001	Yes
Murrabit	6 Monthly	2	<0.0001	Yes
Piangil	6 Monthly	2	<0.0001	Yes
Red Cliffs	6 Monthly	2	<0.0001	Yes
Robinvale	6 Monthly	2	<0.0001	Yes
Swan Hill	6 Monthly	2	<0.0001	Yes

Table 14 Pentachlorophenol - Entry Point

Health Guideline Value (ADWG) 0.01 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Met ADWG guideline value (Yes/No)
Kerang	6 Monthly	2	<0.001	Yes
Koondrook	6 Monthly	2	<0.001	Yes
Mildura	6 Monthly	3	<0.001	Yes
Murrabit	6 Monthly	2	<0.001	Yes
Piangil	6 Monthly	2	<0.001	Yes
Red Cliffs	6 Monthly	2	<0.001	Yes
Robinvale	6 Monthly	2	<0.001	Yes
Swan Hill	6 Monthly	2	<0.001	Yes

Table 15 Tetrachloroethene – Entry Point

Health Guideline Value (ADWG) 0.05 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Met ADWG guideline value (Yes/No)
Kerang	6 Monthly	2	<0.001	Yes
Koondrook	6 Monthly	2	<0.001	Yes
Mildura	6 Monthly	3	<0.001	Yes
Murrabit	6 Monthly	2	<0.001	Yes
Piangil	6 Monthly	2	<0.001	Yes
Red Cliffs	6 Monthly	2	<0.001	Yes
Robinvale	6 Monthly	2	<0.001	Yes
Swan Hill	6 Monthly	2	<0.001	Yes

Table 16 2,4,6-trichlorophenol – Entry Point

Health Guideline Value (ADWG) 0.02 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Met ADWG guideline value (Yes/No)
Kerang	6 Monthly	2	<0.001	Yes
Koondrook	6 Monthly	2	<0.001	Yes
Mildura	6 Monthly	3	<0.001	Yes
Murrabit	6 Monthly	2	<0.001	Yes
Piangil	6 Monthly	2	<0.001	Yes
Red Cliffs	6 Monthly	2	<0.001	Yes
Robinvale	6 Monthly	2	<0.001	Yes
Swan Hill	6 Monthly	2	<0.001	Yes

Table 17 Sulphate – Entry Point

Aesthetic Guideline Value (ADWG) 250 mg/L

Samples are taken from water exiting treatment plants.

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Average (mg/L)	Average change Comparison of past 2 reporting periods	Met ADWG guideline value (Yes/No)
Kerang	3 Monthly	4	54	41.7	Decreased	Yes
Koondrook	3 Monthly	4	16	15.5	Decreased	Yes
Mildura	3 Monthly	7	34	26.3	Increased	Yes
Murrabit	3 Monthly	4	4	2.5	Decreased	Yes
Piangil	3 Monthly	4	8	4.0	Increased	Yes
Red Cliffs	3 Monthly	4	34	28.0	Increased	Yes
Robinvale	3 Monthly	4	42	30.2	Decreased	Yes
Swan Hill	3 Monthly	4	10	5.5	Increased	Yes

Table 18 Arsenic

Health Guideline Value (ADWG) 0.01 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Met ADWG guideline value (Yes/No)
Kerang	3 Monthly	4	<0.001	Yes
Koondrook	3 Monthly	4	<0.001	Yes
Mildura	3 Monthly	7	<0.001	Yes
Murrabit	3 Monthly	4	<0.001	Yes
Piangil	3 Monthly	4	<0.001	Yes
Red Cliffs	3 Monthly	4	<0.001	Yes
Robinvale	3 Monthly	4	<0.001	Yes
Swan Hill	3 Monthly	4	<0.001	Yes

Table 19 Selenium

Health Guideline Value (ADWG) 0.01 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Met ADWG guideline value (Yes/No)
Kerang	3 Monthly	4	<0.001	Yes
Koondrook	3 Monthly	4	<0.001	Yes
Mildura	3 Monthly	7	<0.001	Yes
Murrabit	3 Monthly	4	<0.001	Yes
Piangil	3 Monthly	4	<0.001	Yes
Red Cliffs	3 Monthly	4	<0.001	Yes
Robinvale	3 Monthly	4	<0.001	Yes
Swan Hill	3 Monthly	4	<0.001	Yes

Table 20 Mercury (Entry Point)

Health Guideline Value (ADWG) 0.001 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Met ADWG guideline value (Yes/No)
Kerang	3 Monthly	4	<0.0001	Yes
Koondrook	3 Monthly	4	0.0002	Yes
Mildura	3 Monthly	7	<0.0001	Yes
Murrabit	3 Monthly	4	<0.0001	Yes
Piangil	3 Monthly	4	<0.0001	Yes
Red Cliffs	3 Monthly	4	<0.0001	Yes
Robinvale	3 Monthly	4	<0.0001	Yes
Swan Hill	3 Monthly	4	<0.0001	Yes

Table 21 Gross Alpha Activity¹

Health Guideline Value (ADWG) 0.5 Bq/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (Bq/L)	Met ADWG guideline value (Yes/No)
Kerang	5 yearly	1	<0.05	Yes
Koondrook	5 yearly	1	<0.05	Yes
Mildura	5 yearly	2	<0.05	Yes
Murrabit	5 yearly	1	<0.05	Yes
Piangil	5 yearly	1	<0.05	Yes
Red Cliffs	5 yearly	1	<0.05	Yes
Robinvale	5 yearly	1	<0.05	Yes
Swan Hill	5 yearly	1	<0.05	Yes

Table 22 Gross Beta Activity²

Health Guideline Value (ADWG) 0.5 Bq/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (Bq/L)	Met ADWG guideline value (Yes/No)
Kerang	5 yearly	1	<0.1	Yes
Koondrook	5 yearly	1	<0.1	Yes
Mildura	5 yearly	2	<0.1	Yes
Murrabit	5 yearly	1	<0.1	Yes
Piangil	5 yearly	1	<0.1	Yes
Red Cliffs	5 yearly	1	<0.1	Yes
Robinvale	5 yearly	1	<0.1	Yes
Swan Hill	5 yearly	1	<0.1	Yes

¹ Reported results are from 2020 as samples are taken every 5 years from source water for radioactivity monitoring.² Reported results are from 2020 as samples are taken every 5 years from source water for radioactivity monitoring.

Table 23 Lead

Health Guideline Value (ADWG) 0.01 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Met ADWG guideline value (Yes/No)
Irymple	Quarterly	4	<0.001	Yes
Kerang	Quarterly	4	<0.001	Yes
Koondrook	Quarterly	4	<0.001	Yes
Lake Boga	Quarterly	4	<0.001	Yes
Merbein	Quarterly	4	<0.001	Yes
Mildura	Quarterly	4	<0.001	Yes
Murrabit	Quarterly	4	<0.001	Yes
Nyah	Quarterly	4	<0.001	Yes
Nyah West	Quarterly	4	<0.001	Yes
Piangil	Quarterly	4	<0.001	Yes
Red Cliffs	Quarterly	4	<0.001	Yes
Robinvale	Quarterly	4	<0.001	Yes
Swan Hill	Quarterly	4	<0.001	Yes
Woorinen South	Quarterly	4	<0.001	Yes

Note: Maximum values of this parameter remained same in comparison to the previous 2 reporting periods except Nyah West and Robinvale which saw a decrease.

Table 24 Nickel

Health Guideline Value (ADWG) 0.02 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Met ADWG guideline value (Yes/No)
Irymple	Quarterly	4	<0.001	Yes
Kerang	Quarterly	4	0.002	Yes
Koondrook	Quarterly	4	<0.001	Yes
Lake Boga	Quarterly	4	<0.001	Yes
Merbein	Quarterly	4	<0.001	Yes
Mildura	Quarterly	4	<0.001	Yes
Murrabit	Quarterly	4	<0.001	Yes
Nyah	Quarterly	4	<0.001	Yes
Nyah West	Quarterly	4	<0.001	Yes
Piangil	Quarterly	4	<0.001	Yes
Red Cliffs	Quarterly	4	<0.001	Yes
Robinvale	Quarterly	4	<0.001	Yes
Swan Hill	Quarterly	4	<0.001	Yes
Woorinen South	Quarterly	4	<0.001	Yes

Note: The maximum values of this parameter have remained same in comparison to the previous 2 reporting periods for all Water Sampling Locations except for Kerang.

Table 25 Zinc

Aesthetic Guideline Value (ADWG) 3 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Average (mg/L)	Average change Comparison of past 2 reporting periods	Met ADWG guideline value (Yes/No)
Irymple	Quarterly	4	0.005	0.004	Decreased	Yes
Kerang	Quarterly	4	0.009	0.006	Decreased	Yes
Koondrook	Quarterly	4	0.005	0.004	Decreased	Yes
Lake Boga	Quarterly	4	0.005	0.002	No change	Yes
Merbein	Quarterly	4	0.009	0.006	Decreased	Yes
Mildura	Quarterly	4	0.016	0.007	Decreased	Yes
Murrabit	Quarterly	4	0.011	0.007	Decreased	Yes
Nyah	Quarterly	4	0.006	0.003	Decreased	Yes
Nyah West	Quarterly	4	0.006	0.005	Decreased	Yes
Piangil	Quarterly	4	0.006	0.003	Decreased	Yes
Red Cliffs	Quarterly	4	0.011	0.010	Decreased	Yes
Robinvale	Quarterly	4	0.014	0.009	Decreased	Yes
Swan Hill	Quarterly	4	0.006	0.003	Decreased	Yes
Woorinen South	Quarterly	4	0.016	0.007	Decreased	Yes

Table 26 Nitrogen (as Nitrate)

Health Guideline Value (ADWG) 50 mg/L (as Nitrate)

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Average (mg/L)	Average change Comparison of past 2 reporting periods	Met ADWG guideline value (Yes/No)
Irymple	Quarterly	4	0.05	0.026	Decreased	Yes
Kerang	Quarterly	4	0.12	0.077	Decreased	Yes
Koondrook	Quarterly	4	0.28	0.080	Increased	Yes
Lake Boga	Quarterly	4	0.14	0.1046	Decreased	Yes
Merbein	Quarterly	4	0.03	0.021	Decreased	Yes
Mildura	Quarterly	4	0.05	0.020	Decreased	Yes
Murrabit	Quarterly	4	0.07	0.050	Decreased	Yes
Nyah	Quarterly	4	0.07	0.029	Decreased	Yes
Nyah West	Quarterly	4	0.25	0.084	Decreased	Yes
Piangil	Quarterly	4	0.09	0.036	Decreased	Yes
Red Cliffs	Quarterly	4	0.10	0.030	Decreased	Yes
Robinvale	Quarterly	4	0.16	0.080	Increased	Yes
Swan Hill	Quarterly	4	0.21	0.060	Increased	Yes
Woorinen South	Quarterly	4	0.07	0.026	Decreased	Yes

Table 27 Cyanide

Health Guideline Value (ADWG) 0.08 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Met ADWG guideline value (Yes/No)
Irymple	Quarterly	4	<0.005	Yes
Kerang	Quarterly	4	<0.005	Yes
Koondrook	Quarterly	4	<0.005	Yes
Lake Boga	Quarterly	4	<0.005	Yes
Merbein	Quarterly	4	<0.005	Yes
Mildura	Quarterly	4	<0.005	Yes
Murrabit	Quarterly	4	<0.005	Yes
Nyah	Quarterly	4	<0.005	Yes
Nyah West	Quarterly	4	<0.005	Yes
Piangil	Quarterly	4	<0.005	Yes
Red Cliffs	Quarterly	4	<0.005	Yes
Robinvale	Quarterly	4	<0.005	Yes
Swan Hill	Quarterly	4	<0.005	Yes
Woorinen South	Quarterly	4	<0.005	Yes

Note: The min/max values of this parameter have remained the same in comparison to the previous 2 reporting periods, except for Nyah, Nyah West, Piangil and Robinvale which saw a decrease.

Table 28 Chromium

Health Guideline Value (ADWG) 0.05 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Met ADWG guideline value (Yes/No)
Irymple	Quarterly	4	<0.001	Yes
Kerang	Quarterly	4	<0.001	Yes
Koondrook	Quarterly	4	<0.001	Yes
Lake Boga	Quarterly	4	<0.001	Yes
Merbein	Quarterly	4	<0.001	Yes
Mildura	Quarterly	4	<0.001	Yes
Murrabit	Quarterly	4	<0.001	Yes
Nyah	Quarterly	4	<0.001	Yes
Nyah West	Quarterly	4	<0.001	Yes
Piangil	Quarterly	4	0.001	Yes
Red Cliffs	Quarterly	4	<0.001	Yes
Robinvale	Quarterly	4	<0.001	Yes
Swan Hill	Quarterly	4	<0.001	Yes
Woorinen South	Quarterly	4	<0.001	Yes

Note: Max values of this parameter have Remained the same in comparison to the previous 2 reporting periods except for Woorinen South which saw a decrease and Piangil an increase compared to FY 23-24.

Table 29 Cadmium

Health Guideline Value (ADWG) 0.002 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Met ADWG guideline value (Yes/No)
Irymple	Quarterly	4	<0.0002	Yes
Kerang	Quarterly	4	<0.0002	Yes
Koondrook	Quarterly	4	<0.0002	Yes
Lake Boga	Quarterly	4	<0.0002	Yes
Merbein	Quarterly	4	<0.0002	Yes
Mildura	Quarterly	4	<0.0002	Yes
Murrabit	Quarterly	4	<0.0002	Yes
Nyah	Quarterly	4	<0.0002	Yes
Nyah West	Quarterly	4	<0.0002	Yes
Piangil	Quarterly	4	<0.0002	Yes
Red Cliffs	Quarterly	4	<0.0002	Yes
Robinvale	Quarterly	4	<0.0002	Yes
Swan Hill	Quarterly	4	<0.0002	Yes
Woorinen South	Quarterly	4	<0.0002	Yes

Note: The min/max values of this parameter have Remained the same in comparison to the previous 2 reporting periods.

Table 30 Copper

Water Quality Standard: Total concentration of copper in drinking water should not exceed 2.0 mg/L.

Water Sampling Locality	Frequency of Sampling	Number of Samples	Drinking water quality standard (mg/L)	Maximum (mg/L)	Average (mg/L)	Average change Comparison of past 2 reporting periods	Number of samples where standard was not met (s. 18)
Irymple	Quarterly	4	2	0.009	0.005	Increased	0
Kerang	Quarterly	4	2	0.140	0.038	Increased	0
Koondrook	Quarterly	4	2	0.016	0.009	Decreased	0
Lake Boga	Quarterly	4	2	0.006	0.004	Decreased	0
Merbein	Quarterly	4	2	0.007	0.006	Decreased	0
Mildura	Quarterly	4	2	0.014	0.006	Increased	0
Murrabit	Quarterly	4	2	0.015	0.009	Decreased	0
Nyah	Quarterly	4	2	0.022	0.011	Decreased	0
Nyah West	Quarterly	4	2	0.025	0.015	Decreased	0
Piangil	Quarterly	4	2	0.007	0.005	Decreased	0
Red Cliffs	Quarterly	4	2	0.034	0.017	Increased	0
Robinvale	Quarterly	4	2	0.035	0.014	Decreased	0
Swan Hill	Quarterly	4	2	0.022	0.008	Decreased	0
Woorinen South	Quarterly	4	2	0.017	0.012	Increased	0

Table 31 Manganese

Health Guideline Value (ADWG) 0.5 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Met ADWG guideline value (Yes/No)
Irymple	Quarterly	4	0.140	Yes
Kerang	Quarterly	4	0.180	Yes
Koondrook	Quarterly	4	0.007	Yes
Lake Boga	Quarterly	4	0.003	Yes
Merbein	Quarterly	4	0.004	Yes
Mildura	Quarterly	4	0.014	Yes
Murrabit	Quarterly	4	0.013	Yes
Nyah	Quarterly	4	<0.001	Yes
Nyah West	Quarterly	4	<0.001	Yes
Piangil	Quarterly	4	0.002	Yes
Red Cliffs	Quarterly	4	0.016	Yes
Robinvale	Quarterly	4	0.009	Yes
Swan Hill	Quarterly	4	<0.001	Yes
Woorinen South	Quarterly	4	<0.001	Yes

Table 32 pH

Aesthetic Guideline Range (ADWG) 6.5-8.5 pH

Water Sampling Locality	Frequency of Sampling	Number of Samples	Minimum	Maximum	Average	Average change Comparison of past 2 reporting periods	Aesthetic operating range
Irymple	Weekly	52	7.0	7.6	7.3	Increased	6.5-8.5
Kerang	Weekly	52	7.2	7.7	7.4	Increased	6.5-8.5
Koondrook	Weekly	52	7.0	7.7	7.3	Decreased	6.5-8.5
Lake Boga	Weekly	52	7.3	7.8	7.7	Increased	6.5-8.5
Merbein	Weekly	52	7.1	7.5	7.3	Increased	6.5-8.5
Mildura	Weekly	52	7.0	7.5	7.3	Increased	6.5-8.5
Murrabit	Weekly	52	7.1	7.6	7.4	Increased	6.5-8.5
Nyah	Weekly	52	7.2	7.7	7.4	Increased	6.5-8.5
Nyah West	Weekly	52	7.3	7.7	7.5	Increased	6.5-8.5
Piangil	Weekly	52	7.1	7.7	7.4	Increased	6.5-8.5
Red Cliffs	Weekly	52	7.0	7.6	7.4	Increased	6.5-8.5
Robinvale	Weekly	52	7.0	7.5	7.3	Increased	6.5-8.5
Swan Hill	Weekly	52	7.4	7.7	7.6	Increased	6.5-8.5
Woorinen South	Weekly	52	7.3	7.7	7.6	Increased	6.5-8.5

Table 33 Colour

Aesthetic Guideline Value (ADWG) 15 HU

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum Pt/Co Units ¹	Average Pt/Co Units	Average change Comparison of past 2 reporting periods	Met ADWG guideline value (Yes/No)
Irymple	Monthly	12	2	<2	Increased	Yes
Kerang	Monthly	12	2	<2	Increased	Yes
Koondrook	Monthly	12	4	<2	Increased	Yes
Lake Boga	Monthly	12	<2	<2	No change	Yes
Merbein	Monthly	12	2	<2	Decreased	Yes
Mildura	Monthly	12	2	<2	Increased	Yes
Murrabit	Monthly	12	2	<2	Increased	Yes
Nyah	Monthly	12	<2	<2	No change	Yes
Nyah West	Monthly	12	<2	<2	No change	Yes
Piangil	Monthly	12	4	<2	Increased	Yes
Red Cliffs	Monthly	12	2	<2	Increased	Yes
Robinvale	Monthly	12	25 ²	3	Increased	Yes
Swan Hill	Monthly	12	<2	<2	No change	Yes
Woorinen South	Monthly	12	<2	<2	No change	Yes

¹ Pt-Co Units = Hazen Units (HU) = PCU = Platinum Cobalt Colour² The elevated result was due to sampling error.

Table 34 Iron

Aesthetic Guideline Value (ADWG) 0.3 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Met ADWG guideline value (Yes/No)
Irymple	Quarterly	4	0.90 ¹	No
Kerang	Quarterly	4	0.04	Yes
Koondrook	Quarterly	4	0.02	Yes
Lake Boga	Quarterly	4	0.02	Yes
Merbein	Quarterly	4	0.02	Yes
Mildura	Quarterly	4	0.12	Yes
Murrabit	Quarterly	4	0.02	Yes
Nyah	Quarterly	4	0.01	Yes
Nyah West	Quarterly	4	0.02	Yes
Piangil	Quarterly	4	0.13	Yes
Red Cliffs	Quarterly	4	0.01	Yes
Robinvale	Quarterly	4	0.01	Yes
Swan Hill	Quarterly	4	0.01	Yes
Woorinen South	Quarterly	4	0.02	Yes

Table 35 Hardness (as CaCO₃) – Entry Point

Aesthetic Guideline Value (ADWG) 200 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Average (mg/L)	Average change Comparison of past 2 reporting periods	Met ADWG guideline value (Yes/No)
Kerang	Quarterly	4	67	48.25	Decreased	Yes
Koondrook	Quarterly	4	24	19.00	Decreased	Yes
Mildura	Quarterly	7	56	43.29	Decreased	Yes
Murrabit	Quarterly	4	13	19.50	Decreased	Yes
Piangil	Quarterly	4	31	24.50	Decreased	Yes
Red Cliffs	Quarterly	4	68	40.75	Increased	Yes
Robinvale	Quarterly	4	44	32.00	Decreased	Yes
Swan Hill	Quarterly	4	41	29.25	Decreased	Yes

¹ The elevated result was from a sample that is at the end of the network.

Table 36 Chloride – Entry Point

Aesthetic Guideline Value (ADWG) 250 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Average (mg/L)	Average change Comparison of past 2 reporting periods	Met ADWG guideline value (Yes/No)
Kerang	Quarterly	4	21	16.2	Decreased	Yes
Koondrook	Quarterly	4	14	9.5	Decreased	Yes
Mildura	Quarterly	7	41	30.4	Decreased	Yes
Murrabit	Quarterly	4	15	11.2	Decreased	Yes
Piangil	Quarterly	4	29	19.2	Decreased	Yes
Red Cliffs	Quarterly	4	40	30.5	Decreased	Yes
Robinvale	Quarterly	4	37	23.2	Decreased	Yes
Swan Hill	Quarterly	4	44	28.0	Decreased	Yes

Table 37 Sodium

Aesthetic Guideline Value (ADWG) 180 mg/L

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Average (mg/L)	Average change Comparison of past 2 reporting periods	Met ADWG guideline value (Yes/No)
Kerang	Quarterly	4	20	16.2	Decreased	Yes
Koondrook	Quarterly	4	11	9.6	Decreased	Yes
Mildura	Quarterly	7	29	19.4	Decreased	Yes
Murrabit	Quarterly	4	9.2	7.3	Decreased	Yes
Piangil	Quarterly	4	13	9.2	Decreased	Yes
Red Cliffs	Quarterly	4	38	26.2	Decreased	Yes
Robinvale	Quarterly	4	35	24.5	Decreased	Yes
Swan Hill	Quarterly	4	21	15.5	Decreased	Yes

Table 38 Electrical Conductivity

Aesthetic Guideline Value (ADWG) <895 µS/cm¹

ADWG has no specific guidelines values for Electrical Conductivity (EC) but specifies an Aesthetic Guideline Value of 600 mg/L for Total Dissolved Solids (TDS). Approximate EC value has been calculated from following correlation between TDS and EC.

$$EC = \frac{TDS}{k}$$

Where k has been taken as 0.67.

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (µS/cm)	Average (µS/cm)	Average change Comparison of past 2 reporting periods	Met ADWG guideline value (Yes/No)
Kerang	Quarterly	4	250	197.5	Decreased	Yes
Koondrook	Quarterly	4	110	99.5	Decreased	Yes
Mildura	Quarterly	7	240	208.6	Decreased	Yes
Murrabit	Quarterly	4	100	83.5	Decreased	Yes
Piangil	Quarterly	4	150	110.2	Decreased	Yes
Red Cliffs	Quarterly	4	240	207.5	Decreased	Yes
Robinvale	Quarterly	4	250	210.0	Decreased	Yes
Swan Hill	Quarterly	4	200	152.5	Decreased	Yes

Table 39 Calcium

No Guideline Value

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Average (mg/L)
Kerang	Quarterly	4	19.0	13.0
Koondrook	Quarterly	4	3.9	3.4
Mildura	Quarterly	7	13.0	9.3
Murrabit	Quarterly	4	4.0	3.4
Piangil	Quarterly	4	5.1	4.3
Red Cliffs	Quarterly	4	8.8	6.2
Robinvale	Quarterly	4	7.3	5.7
Swan Hill	Quarterly	4	6.0	4.7

¹ Calculated for TDS aesthetic guideline value of 600 mg/L

Table 40 Alkalinity (as CaCO₃) – Entry Point

No Guideline Value

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Average (mg/L)	Average change Comparison of past 2 reporting periods
Kerang	Quarterly	4	28	24.2	Decreased
Koondrook	Quarterly	4	15	14.0	Decreased
Mildura	Quarterly	7	24	20.9	Decreased
Murrabit	Quarterly	4	25	19.5	Decreased
Piangil	Quarterly	4	21	18.5	Decreased
Red Cliffs	Quarterly	4	23	18.8	Decreased
Robinvale	Quarterly	4	40	31.0	Decreased
Swan Hill	Quarterly	4	26	25.0	Decreased

Table 41 Magnesium – Entry Point

No Guideline Value

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum (mg/L)	Average (mg/L)	Average change Comparison of past 2 reporting periods
Kerang	Quarterly	4	4.5	3.7	Decreased
Koondrook	Quarterly	4	3.4	2.5	Decreased
Mildura	Quarterly	7	6.3	4.9	Decreased
Murrabit	Quarterly	4	2.2	2.6	Decreased
Piangil	Quarterly	4	4.5	3.3	Decreased
Red Cliffs	Quarterly	4	11	6.1	Increased
Robinvale	Quarterly	4	6.2	4.3	Decreased
Swan Hill	Quarterly	4	6.3	4.2	Decreased

Table 42 Escherichia coli (E. coli) – Remote Storage/Entry Point

Drinking Water Quality Standard: All samples of drinking water collected must contain no Escherichia coli per 100 millilitres of drinking water, with exception of any false positive sample.

Water Sampling Locality	Frequency of Sampling	Number of Samples	Maximum detected (CFU/100mL)	Number of detections and investigations conducted (s.22)	Number of samples where standard was not met (s.18)
Kerang	Fortnightly	26	0	0	0
Koondrook	Fortnightly	26	0	0	0
Lake Boga	Fortnightly	25	0	0	0
Merbein	Fortnightly	27	0	0	0
Mildura	Fortnightly	48	0	0	0
Murrabit	Fortnightly	26	0	0	0
Nyah	Fortnightly	26	1	1	1
Nyah West	Fortnightly	26	0	0	0
Piangil	Fortnightly	26	0	0	0
Red Cliffs	Fortnightly	27	0	0	0
Robinvale	Fortnightly	26	0	0	0
Swan Hill	Fortnightly	26	0	0	0
Woorinen	Fortnightly	26	0	0	0

Table 43 Fluoride – Entry Point

Fluoride is added to the drinking water sampling localities listed below to promote oral health as directed by DH. Fluoride samples are taken monthly in each of the fluoridated water sampling localities. No fluoride data is available for Koondrook, Murrabit and Piangil systems as these systems do not have fluoridation.

Drinking Water Quality Standard: The total concentration of fluoride in drinking water should not exceed 1.5 mg/L.

Compliance: Annual average fluoride level must not exceed 1 milligram per litre and all individual samples must be less than 1.5 milligrams per litre fluoride concentrations under s.5 (3) of Health (Fluoridation) Act 1973.

Water Sampling Locality	Frequency of Sampling	Number of Samples	Drinking water quality standard (mg/L)	Target optimum operating fluoride concentration (mg/L)	Maximum (mg/L)	Average (mg/L)	Number of samples where standard was not met (s.18)
Kerang	Quarterly	4	1.5	0.8	0.82	0.73	0
Mildura	Quarterly	7	1.5	0.8	0.82	0.59	0
Red Cliffs	Quarterly	4	1.5	0.8	0.80	0.76	0
Robinvale	Quarterly	4	1.5	0.8	0.85	0.71	0
Swan Hill	Quarterly	4	1.5	0.8	0.71	0.78	0



LOWER MURRAY WATER

Mildura (Head Office)

741-759 Fourteenth Street
Mildura Victoria 3500
PO Box 1438
Mildura Victoria 3502

Swan Hill (Area Office)

73 Beveridge Street
Swan Hill Victoria 3585
PO Box 1447
Swan Hill Victoria 3585

Kerang (Area Office)

56 Wellington Street
Kerang Victoria 3579
PO Box 547
Kerang Victoria 3579

www.lmw.vic.gov.au